

RECOMMENDATIONS FOR CLIMATE FRIENDLY REFRIGERANT MANAGEMENT AND PROCUREMENT

Developed by the Sustainable Purchasing Leadership Council (SPLC) Action Team on Climate Friendly Refrigerants, in partnership with the Institute for Governance & Sustainable Development (IGSD).

This document is the updated edition of the Recommendations for Climate Friendly Refrigerant Management and Procurement authored by the SPLC Climate Friendly Refrigerant Action Team. The Climate Friendly Refrigerant Action Team is dedicated to investigating global regulatory and voluntary programs to avoid and/or reduce emissions from high global warming potential (GWP) HFCs. This document identifies opportunities and specific procurement options 1) to avoid high GWP HFC refrigerants when purchasing new energy efficient refrigeration and air conditioning equipment, and 2) to reduce refrigerant leakage and service emissions. We invite you to read and put this work to use in your own procurement processes, and to offer additional insights and experiences to sharpen and improve the guidance over time.

Publication Date

September 22, 2021

This document updates and replaces the original Procurement Recommendations for Climate Friendly Refrigerants version 1.0, published in September 2020.

ACTION TEAM MEMBERS



Johanna Anderson (Co-Chair)
SPLC



Stephen O. Andersen (Co-Chair)
IGSD



Kristen N. Taddonio (Co-Chair)
IGSD



Kimberly Bawden
New York State Pollution Prevention Institute



Abbey Brown
Washington Department of Ecology



Jonathan Rivin
Oregon Department of Environmental Quality



Kshirajaa Ramesh
Maryland Department of General Services

ACTION TEAM GUIDANCE REVIEWERS

Thank you to the following individuals who reviewed this and earlier versions of the guidance:

- Kirsten Cappel, United States Environmental Protection Agency (EPA)
- Tilden Chao, Yale Refrigerants Initiative
- Bruce Ernst, A-Gas, Inc.
- Alex Hillbrand, Natural Resources Defense Council (NRDC)
- Adam Meier, Harvard University
- Pete Pasterz, Oregon Department of Environmental Quality
- Christina Starr, Environmental Investigation Agency (EIA)

TABLE OF CONTENTS

Action Team Members	2
Guidance	
1. Getting started	4
2. Take action	10
3. Specifications	21
Appendices	
A: What are HFCs and why are they being phased down?	25
B: Characteristics of common refrigerants.....	28
C: Larger equipment.....	32
D: Tools, resources, certifications and product lists.....	36
E: Details of the Montreal Protocol on Substances that Deplete the Ozone Layer and the 2016 Kigali Amendment on HFCs	39
Acronyms.....	42

1. GETTING STARTED

Are you ready to take action on avoiding obsolete [hydrofluorocarbon \(HFC\) greenhouse gas refrigerants](#) that (1) are often [prohibited under various state laws](#); (2) are being phased down in the United States with the passage of the [American Innovation and Manufacturing Act](#) in December 2020; and (3) are being phased down globally under the [Kigali Amendment](#) to the Montreal Protocol on Substances that Deplete the Ozone Layer (Montreal Protocol)?

This procurement toolkit is designed to help you (1) minimize the climate harm of obsolete refrigerants in your existing equipment, and (2) select affordable, energy efficient heating and cooling equipment¹ that uses next-generation refrigerants that are more climate friendly.

While this toolkit focuses on avoiding climate change impacts of HFCs, it also takes into consideration refrigerant flammability, toxicity, and atmospheric fate of the replacement refrigerants. This document focuses on small heating, cooling, and refrigeration equipment where climate friendly alternatives are more readily available, cost effective, and compliant with United States environmental and safety standards.

What is a refrigerant?

A refrigerant is a substance or mixture, usually a fluid at ambient conditions, used in air conditioners, heat pumps, and refrigerators to produce a cooling effect.

Why do refrigerants matter?

Presently, the most common refrigerants in use are hydrofluorocarbons (HFCs). HFCs have high global warming potentials (GWPs), thousands of times that of carbon dioxide (CO₂). They are also usually short-lived, so their environmental damage is concentrated in the short run (the next decade or two). Reducing the production and consumption of high GWP HFCs can mitigate 70–100 billion tonnes of CO₂ equivalent (CO₂-eq) by 2050, and prevent up to 0.5 degrees Celsius increase in the Earth's temperature by 2100. Prioritizing energy efficient technologies in the refrigeration and air conditioning sector could potentially double these benefits.

Source: [Climate and Clean Air Coalition to Reduce Short-Lived Climate Pollutants](#)

Currently, under the Kigali Amendment to the Montreal Protocol, HFCs are being phased down and replaced with environmentally superior refrigerants that are less damaging to the climate (see Appendix E for more details). These alternatives include hydrofluoroolefins (HFOs), lower-impact HFCs, and in some applications refrigerants like ammonia, hydrocarbons, or even CO₂, which can also be used as refrigerant. In many cases, climate friendly refrigerants can provide higher energy efficiency, too.

¹ Refrigerators, freezers, air conditioners, heat pumps, ice makers, vending machines and more

What is the Climate Friendly Refrigerants Action Team?

The Sustainable Purchasing Leadership Council (SPLC) and the Institute for Governance & Sustainable Development (IGSD) recruited experts from sustainable procurement offices of Maryland, New York, Oregon, and Washington plus the Sustainable Food Trade Association (SFTA) to combine experience and wisdom in assembling this procurement tool kit to implement public and private policy to require climate friendly refrigerants in high efficiency equipment.

The approach of the Climate Friendly Refrigerants Action Team has been to focus on actions that require little new research or administrative effort –taking full advantage of work already accomplished by international, national, state, and professional authorities. This document also provides contract language that can be inserted directly into procurement documents to encourage or require suppliers to offer widely available sustainable technologies that are safe for the ozone layer and more friendly to climate.

To help you get a fast start on using procurement to avoid high-GWP HFCs in heating, cooling, and refrigeration appliances, this toolkit concentrates on product categories where next-generation technology is available that:

- Complies with US environmental and safety standards;
- Is commercialized and able to achieve economy of scale;
- Is competitive in price and superior in life cycle carbon footprint; and
- Has in-place supply and service infrastructure.

This toolkit supports compliance with HFC phasedown laws already [passed by several states](#) and will help you prepare for the national HFC phasedown required under the [American Innovation and Manufacturing \(AIM\) Act](#).

WHAT PRODUCTS USE HFCs?

The vast majority of HFC consumption today is in the cooling sector, comprised of refrigeration, air conditioning, and heat pumps (RACHP) in both mobile (vehicle) and stationary (building) applications. These sectors accounted approximately 80 percent of global greenhouse gas (GHG) emissions from HFC consumption, as shown in Figure 1. The remaining 20% is used in foam insulation, aerosol products including medicine, fire extinguishers, and other miscellaneous uses.

HYDROFLUOROCARBONS (HFCs)

HFCs are powerful ma
are rapidly building up

CONSUMPTION

HFCs are a group of industrial chemicals primarily used for air conditioning and refrigeration.

LIFETIME IN ATMOSPHERE:

15 YEARS (AVERAGE WEIGHTED BY USE)


Many HFCs are short-lived climate pollutants. The most abundant of these, HFC-134a, is 3,790 times more damaging to the climate than carbon dioxide (CO₂) over a 20-year period.

RESIDENTIAL, COMMERCIAL AND INDUSTRIAL AIR CONDITIONING AND REFRIGERATION

47%




HFC consumption today...



- 40% filling new equipment
- 60% topping up leaking equipment

Up to 10 air conditioners will be sold every second over the next 30 years

% = global emissions

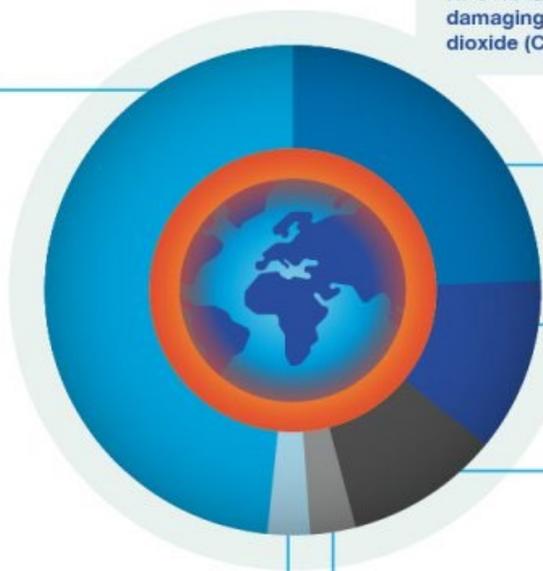

MOBILE AIR CONDITIONING

24%



FOAM AGENTS

11%



UNITARY AIR CONDITIONING

8%



AEROSOLS

5%



FIRE EXTINGUISHERS AND SOLVENTS

5%



Figure 1: Hydrofluorocarbon consumption. Cooling applications (residential, commercial and industrial air conditioning and refrigeration, unitary air conditioning, and mobile air conditioning) account for 79% of global HFC consumption. Credit: Climate and Clean Air Coalition.

Most emissions occur during operations and maintenance and end-of-life of installed refrigeration and air conditioning equipment, so proper servicing, refrigerant recovery, and disposal procedures are very important. This is covered in strategy 4: Insist on Proper Equipment Care and Installation Techniques, and strategy 5: Require Proper Refrigerant Disposal and Materials Recycling.

IMPORTANT CONSIDERATIONS

1. REFRIGERANT MANAGEMENT and CLIMATE FRIENDLY ALTERNATIVE REFRIGERANTS ARE THE #1 OPPORTUNITY TO REDUCE GREENHOUSE GAS EMISSIONS²

According to Project Drawdown, [refrigerant management](#) for existing equipment and [alternative, climate friendly refrigerants](#) in new equipment, if added together, are the #1 climate change mitigation opportunity. Combined, these efforts can avoid the equivalent of over 100 gigatonnes (100 billion metric tonnes) of CO₂ in the next 30 years. Establishing a [refrigerant management program](#) that requires climate friendly refrigerants in new equipment is important.

When it comes to purchasing new equipment, avoid new investment in obsolete HFC technology that will be expensive to operate and service, and contain costs by reducing refrigerant emissions from existing equipment. Retrofitting equipment may be a possibility for some applications, but it is generally more cost effective to replace older equipment, especially if it was inefficient at purchase, poorly installed and/or poorly maintained (see Appendix A).

For existing equipment not yet ready to be replaced, opt for reclaimed refrigerant from an [EPA-certified refrigerant reclaimer](#) when servicing.³ Reclaimed refrigerant is existing refrigerant that has been recovered from equipment at end-of-life and then purified before being reused. This helps prevent atmospheric release of refrigerant from old equipment and displaces demand for virgin refrigerant, thereby minimizing environmental harm. You can currently even earn carbon credits from the American Carbon Registry by using reclaimed refrigerants according to their [Certified Reclaimed Refrigerant Protocol](#).⁴ A reclaimed refrigerant is usually higher in purity than a “recycled” refrigerant, which is refrigerant that is recovered from existing equipment but only filtered, dehydrated, and purged on non-condensable gas before reuse. Motor vehicle manufacturers have globally determined that recycled refrigerant is equivalent in performance to new or reclaimed refrigerant but manufacturers of stationary equipment have not yet endorsed recycled refrigerant.

2. YOU CAN'T MANAGE WHAT YOU DON'T MEASURE

A good refrigerant management plan starts with good data. If your organization conducts a greenhouse gas inventory, you may already have a good start on a refrigerant inventory—crucial for refrigerant management—because HFC refrigerants are included in “scope 1” (direct) emissions. Typically, HFC emissions that are already included in your inventory are from large cooling units with charge sizes more than 50 pounds of refrigerant. Inventories often overlook

² Project Drawdown originally combined refrigerant management and alternative refrigerants into one strategy; they have since divided them into two strategies, but if combined they still add up to the largest emissions reduction opportunity.

³ All reclaimed refrigerants must be certified by an independent lab that it meets the AHRI 700 purity standard. HFC reclamation is becoming increasingly complex often requiring fractional distillation equipment to separate and purify highly mixed HFC recovered refrigerants. EPA certified reclaimers are required to meet the AHRI 700 standard.

⁴ Many people ask “is it possible to replace the refrigerant in my existing AC or refrigeration equipment with a climate friendly alternative? In most cases, unfortunately the answer is no: equipment is designed to use the refrigerant specified. That is why it is important to use reclaimed refrigerant: If you can't replace equipment with new models that use low-GWP refrigerant, a good alternative is to use reclaimed refrigerant until you are ready to replace equipment.

Procurement Recommendations for Climate Friendly Refrigerants

emissions sources from smaller cooling units, such as window air conditioners and office refrigerators.

If you do not have a GHG inventory or a refrigerant management plan, check out these [HFC inventory tools and resources](#) developed for the Federal Government that are free for anyone to use. You can also purchase refrigerant management software available from a variety of vendors (note: SPLC does not endorse any particular product or vendor). The implementation of a Refrigerant Management Plan/Program incorporating leak prevention and repair strategies as well as refrigerant inventory and requirements to recover refrigerant at equipment end of life and use [reclaimed refrigerant](#) when servicing older equipment to minimize the negative impacts of existing refrigeration systems. These strategies, when paired with procuring low-GWP, high efficiency equipment, represent a comprehensive, strategic approach to GHG reduction. IHS has a good [white paper](#), titled *Refrigerant Management Programs & the Bottom Line*.

3. FIND SYNERGY IN DEMAND REDUCTION, LOW-GWP, AND ENERGY EFFICIENCY FOR SUPERIOR LIFE CYCLE CLIMATE PERFORMANCE

Reduce heating and cooling energy use with options like shading and orientation, natural lighting and ventilation, and smart energy management. Reduce refrigeration energy use with building options like thicker thermal insulation, better door seals, and temperature settings that save energy. Once energy loads are minimized, prioritize purchase of efficient equipment that uses climate friendly refrigerant to minimize climate impacts while maximizing energy savings. Life Cycle Climate Performance (LCCP) is a metric for evaluating the combined refrigerant emissions and energy consumption global warming impacts of heating, cooling, and refrigeration systems (equipment and refrigerants) over the life cycle of the system.⁵ LCCP is calculated as the sum of the GHG emissions generated over the life cycle of the system. Fortunately, procurement of many types of refrigeration and heating and cooling equipment can achieve superior LCCP simply by requiring low-GWP refrigerants and equipment with high energy efficiency. Furthermore, robust action in procurement can accelerate the market penetration of low-GWP technology and dramatically reduce GHG emissions.

Low-GWP refrigerants are often more inherently efficient than the high-GWP HFCs they replace. For example, air conditioning units that use R-32 top the ENERGY STAR Most Efficient List, and make up all the top-performing heat pumps listed by [TopTen.eu](#), a site that makes it easy for consumers to find efficient appliances. Likewise, refrigerators achieving the highest efficiency generally use low-GWP refrigerants like R-600a instead of high-GWP HFC-134a. ENERGY STAR's database of energy efficient equipment (the [ENERGY STAR Product Finder](#)) is beginning to allow purchasers to filter by the refrigerant used, allowing procurement officials to choose equipment that meets high energy efficiency standards and uses a low-GWP refrigerant.

SPLC will be working with organizations to add refrigerant information to key databases for even easier access, such as the Air Conditioning, Heating, and Refrigeration Institute (AHRI) and ENERGY STAR product lists and product finder tools.

In the meantime, [ClimateFriendlyCooling.com](#) offers information on energy efficient products that use low-GWP refrigerants, including refrigerators, air conditioners, freezers, laboratory equipment, vending machines, heat pumps, water coolers, and more.

⁵ <https://docs.lib.purdue.edu/cgi/viewcontent.cgi?article=2723&context=iracc>

4. MOTIVATE AND INVOLVE SUPPLIERS

Low-GWP, high-efficiency equipment is widely available at affordable prices but is sometimes offered only when requested. Purchasers should ask for low-GWP product options and avoid obsolete technology and equipment that will be progressively more expensive to maintain as the high-GWP refrigerants become scarcer through the phase down of HFC production and market's shift to new technology.

Where low-GWP options are not yet available, consumers should look for, or request, reclaimed refrigerant, as opposed to newly produced refrigerant, in new equipment.

5. BE MINDFUL OF CHANGES IN HFC LAWS AND REGULATIONS

In the US, the Environmental Protection Agency (EPA) has begun phasing down the production and consumption of HFCs under the [American Innovation and Manufacturing Act](#), which was signed into law in December 2020. By 2036, EPA will phase down HFC production and consumption by 85 percent. EPA also may require high volume product categories, such as stationary air conditioners and commercial refrigerators, to switch to lower GWP refrigerants in all new products manufactured after the mid-2020s. Many states have also enacted new [regulations](#) to phase out high-GWP HFCs.

The ultimate effect of these federal and state actions will be an economy-wide transition from high-GWP HFCs to climate friendly substitutes, significantly constricting virgin production of high-GWP HFCs and leading manufacturers of most product categories transitioning to substitutes over the next decade.

Use [HFCbans.com](https://www.hfc-bans.com) to keep up with the status of these HFC rules and regulations. Globally, many countries have already enacted strict bans on HFCs in air conditioning and refrigeration equipment, and even more laws and regulations are under development as more countries ratify and implement the Kigali Amendment to the Montreal Protocol.

6. RELY ON AUTHORITATIVE SOURCES FOR INFORMATION ON REFRIGERANT ALTERNATIVES AND ACCEPTABLE SUBSTITUTES

The United States Environmental Protection Agency (US EPA) Significant New Alternatives Policy (SNAP) program was established under Section 612 of the Clean Air Act to identify and evaluate substitutes for refrigerants and other ozone-depleting substances that pose lower risk to human health and the environment. The program reviews substitute refrigerants within a comparative risk framework. The SNAP program does not provide a static list of alternatives but instead evolves the list as EPA makes decisions that are informed by its overall understanding of the environmental and human health impacts as well as its current knowledge of available substitutes. Learn more about SNAP and substitutes at: <https://www.epa.gov/snap>.

2. TAKE ACTION

This section will guide you through the process and provide the building blocks necessary for creating a successful plan to purchase energy efficient equipment and appliances that use climate friendly refrigerants. Note that the strategies in this section are not interdependent, nor are they presented in a required order of operation.

STRATEGY 1: INCORPORATE CONSIDERATION OF HFCs INTO EXISTING SUSTAINABLE PROCUREMENT POLICY AND CREATE AN ORGANIZATIONAL HFC POLICY THAT INCLUDES REFRIGERANT MANAGEMENT

Use this guide to understand the products purchased and their uses. Taking these steps will help you earn the support of staff throughout the supply chain. Use the policy template on the following page to create your own policy.

- Take lessons learned from similar companies, agencies, or organizations: what worked, what didn't work, and why? How can you incorporate successful strategies while avoiding pitfalls? Check out the case studies available from the Climate and Clean Air Coalition (CCAC) at: <https://www.ccacoalition.org/en/initiatives/hfc>.
- Check for the latest laws and regulations banning high-GWP HFCs at HFCbans.com and research the local rules and regulations in the markets where you operate.
- Start with cost-effective solutions that can be implemented quickly, such as those included on page 12 in Table 1: *How to Find Commercially Available Products that Use Low GWP Refrigerants*. This will help prove the value of the policy while also earning buy-in from stakeholders through early successes. There is more information on this in Section 2: Select Energy Efficient Low-GWP Technology.
- Remember that [refrigerant management](#) and [alternative climate friendly refrigerants](#) together add up to the #1 global opportunity to reduce greenhouse gas emissions according to [Project Drawdown](#). Borrow from other resources to help your organization establish a refrigerant management plan if you don't have one already. You can look for existing refrigerant management plan [examples](#), and/or [utilize free HFC inventory tools and resources](#) developed to help Federal Agencies measure and manage their HFC emissions. Be sure to require the use of [reclaimed refrigerant](#) to minimize the GHG emissions from existing AC and refrigeration equipment until you replace it with new models that use climate friendly refrigerants. You can even earn carbon credits from the American Carbon Registry by using reclaimed refrigerants according to their [Certified Reclaimed Refrigerant Protocol](#).
- See Section 1 of Specifications for policy language to consider.

Get buy-in from leadership. If you have proven your policy to executive leadership, then they can become an advocate that can help you gain buy-in throughout the organization. Your organization may actually save money through improved efficiency and reduced refrigerant expense.

Create a refrigerant management plan with an inventory, set goals, and track progress. Begin by establishing a baseline and setting goals based on your research, as well as metrics (e.g., key performance indicators) to measure progress toward these goals. Be prepared to

Procurement Recommendations for Climate Friendly Refrigerants

adjust or adapt these goals if needed. Above all, be aware that technologies exist both to replace high GWP HFCs in new equipment and ensure the recovery and reclaim or destruction of high GWP HFCs in existing equipment, such that no material quantity of high GWP HFC should ever be vented or otherwise leak into the atmosphere.

Communicate and celebrate progress toward goals. This applies to leadership as well as staff to maintain support and momentum. Policies are successful when employees understand not only what they need to comply with, but also *why* the policies matter.

Be careful to avoid:

- Reinventing the wheel.
- Creating a policy that duplicates or conflicts with another internal policy.
- Creating undue burden on employees.

Organizational Refrigerant Policy Template

[Organization] shall pursue actions to limit the purchase of equipment containing HFCs (hydrofluorocarbons) and HFC blends with high global warming potentials (GWPs) and seek out reclaimed refrigerant to service existing equipment whenever possible. These actions shall enable *[Organization]* to mitigate increased risks attributed with climate change that impact human and environmental health.

Where opportunities exist, *[Organization]* shall pursue complementary energy efficiency measures to maximize the environmental benefits by prioritizing the purchase of equipment certified by ENERGY STAR.

In addition, where *[Organization]* owns or operates existing equipment containing HFCs and HFC blends, *[Organization]* shall pursue actions to reduce emissions through:

- 1) monitoring refrigerant purchases and use;
- 2) actively identifying and repairing leaks;
- 3) utilizing reclaimed refrigerant from an [EPA-certified refrigerant reclaimer](#); and
- 4) maintaining equipment in proper operating conditions (including recovering and reclaiming or destroying refrigerant at equipment end of life).

As of *[effective date]*, *[Organization]* shall apply this policy to the following end-use categories, as applicable:

- ❖ Refrigeration
 - Vending Machines
 - Water Coolers (e.g., office coolers)
 - Refrigeration Appliances
 - Residential/break room refrigerators
 - Compact refrigerators or freezers (i.e. in hotels and dormitories)
 - Lab-Grade Refrigerators and Freezers
 - Stand-alone type commercial refrigerators and freezers
 - Retail Food Refrigeration
 - Cold Storage Warehouses
- ❖ Air Conditioning Equipment
 - Self-Contained Residential and Commercial AC Units
 - AC Units for Rooms
 - Packaged Terminal AC Units
 - Portable AC Units
 - Unitary AC Systems (e.g., residential split systems)
 - Building Chillers
 - Other types of AC and Heat-Pump equipment where climate-friendly alternatives are available
 - Motor Vehicle Air Conditioning Equipment

STRATEGY 2: SELECT ENERGY EFFICIENT, LOW-GWP TECHNOLOGY

Many product categories have a large number of energy efficient, cost-effective, low-GWP options that comply with US and International safety and environmental standards. *Wherever possible, choose equipment certified for high energy efficiency and utilize low-GWP refrigerants.* The [EPA Energy Star Product Finder](#) is an excellent source of efficient products, and for certain product categories, the database also indicates options for refrigerants. [ClimateFriendlyCooling.com](#) also has lists of Energy Star qualified product models that contain low-GWP refrigerants.

Table 1 provides information on how to find commercially available energy efficient products that use low-GWP refrigerants for domestic refrigerators and freezers, commercial stand-alone refrigerators and freezers, lab-grade refrigerators and freezers, commercial ice makers, vending machines, water coolers, room air conditioners, and vehicles. Many of these products are also ENERGY STAR certified. (Note: References to specific brands do not indicate nor imply endorsement.) For more discussion of maintenance and end-of-life procedures for these products and equipment, please see Specifications, Section 3.

TABLE 1: HOW TO FIND COMMERCIALLY AVAILABLE ENERGY EFFICIENT PRODUCTS THAT USE CLIMATE FRIENDLY REFRIGERANTS

<p>ENERGY STAR qualified commercial refrigerators (stand-alone type)</p> <p>Refrigerant Type</p> <ul style="list-style-type: none"> <input type="checkbox"/> Other (2) <input type="checkbox"/> R-134a (37) <input type="checkbox"/> R-290 (956) <input type="checkbox"/> R-404A (20) <input type="checkbox"/> R-450A (8) <input type="checkbox"/> R-600a (102) 	<p>Commercial refrigerators and freezers that have earned the ENERGY STAR are on average 20 percent more energy efficient than standard models because they are designed with components such as improved evaporator and condenser fan motors, hot gas anti-sweat heaters, and/or high-efficiency compressors, which significantly reduce energy consumption and utility bills.</p> <p>Visit ClimateFriendlyCooling.com or use the Energy Star “Product Finder” at https://www.energystar.gov/productfinder</p> <p>Select low-GWP refrigerants such as R-290 or R-600a (both have GWPs<1). Avoid or prohibit purchasing models with refrigerants R-134a (GWP=1,300) or R-404A* (GWP=3,943).</p> <p>*R-404A is a blend made up of 44% HFC-125 (GWP=3170), 52% HFC-143a (GWP=4800), and 4% HFC-134a (GWP=1300).</p>
<p>ENERGY STAR qualified commercial ice makers</p>	<p>Automatic commercial ice makers are used in restaurants, bars, hotels, hospitals and a variety of commercial and industrial facilities for both food and patient care applications. According to ENERGY STAR, certified batch-type ice makers save businesses 700 kWh and \$75 annually and \$660 over the product’s lifetime on utility bills. Certified continuous-type ice</p>

<p>Refrigerant Type</p> <ul style="list-style-type: none"> <input type="checkbox"/> R-134a (37) <input type="checkbox"/> R-290 (3) <input type="checkbox"/> R-404A (13) <input type="checkbox"/> R-410A (8) <input type="checkbox"/> R-600a (22) 	<p>makers save businesses 1,350 kWh and \$145 annually and \$1,260 over the product’s lifetime on utility bills.⁶ Fortunately, ENERGY STAR allows people to see what refrigerants these commercial icemakers use.</p> <p>To find products, visit ClimateFriendlyCooling.com or use the Energy Star “Product Finder” at: https://www.energystar.gov/productfinder</p> <p>Climate friendly refrigerant options include R-290 and R-600a.</p> <p>Avoid or prohibit purchasing models that use R-134a, R-404A, or R-410A</p>
<p>ENERGY STAR qualified domestic refrigerators and freezers</p> 	<p>Thanks to recent improvements in thermal insulation and inverter technology, today’s refrigerators use much less energy than older models. With an ENERGY STAR certified refrigerator, you can maximize your energy and dollar savings without sacrificing the features you want. According to Energy Star, “an estimated 190 million refrigerators and refrigerator-freezers are currently in use in the United States. More than 69 million refrigerators are over 10 years old, costing consumers \$4.9 billion a year in energy costs. By properly recycling your old refrigerator and replacing it with a new ENERGY STAR certified refrigerator, you can save more than \$300 over the next 5 years.”⁷</p> <p>To find efficient products that use climate friendly refrigerants, visit ClimateFriendlyCooling.com or EIA’s Buyer Guide for HFC-free refrigerators.</p> <p>Avoid or prohibit purchasing models that use R-134a.</p>
<p>ENERGY STAR qualified lab-grade refrigerators and freezers</p>	<p>Laboratory grade refrigerators and freezers are used specifically for storing non-volatile reagents and biological specimens in laboratory settings, including hospitals, clinics, university and government research laboratories, and pharmaceutical manufacturing plants. They are designed to contain chemicals or biological specimens at stable, low temperatures. The ENERGY STAR label will appear on laboratory grade refrigerators and freezers across a range of product types and sizes, allowing customers to purchase</p>

⁶ https://www.energystar.gov/products/commercial_food_service_equipment/commercial_ice_makers


⁷ <https://www.energystar.gov/products/appliances/refrigerators>

 <p>Refrigerant Type: R-290</p>	<p>efficient products right sized and properly controlled for their sample needs.</p> <p>To find products, visit ClimateFriendlyCooling.com or use the ENERGY STAR Product Finder to locate efficient models: https://www.energystar.gov/productfinder/product/certified-lab-grade-refrigeration.</p> <p>ENERGY STAR includes “refrigerant type” in the product specifications for laboratory grade refrigerators and freezers so you can conveniently identify low-GWP models. The vast majority of qualified models use low-GWP refrigerants such as R-290, R-600a, or R-744 (GWPs = or less than 1).</p> <p>Avoid or prohibit purchasing models that use R-404A (GWP=3,943).</p>
<p>ENERGY STAR qualified vending machines</p> 	<p>ENERGY STAR certified refrigerated beverage vending machines are on average 40% more efficient and save about 1,000 kWh annually.⁸ Several ENERGY STAR-qualified product manufacturers offer units with low-GWP refrigerants instead of high-GWP refrigerants like HFC-134a (GWP=1,300).</p> <p>To find products, visit ClimateFriendlyCooling.com. You can also find efficient models with the ENERGY STAR Product Finder tool: https://www.energystar.gov/productfinder</p> <p>Require your supplier to offer only equipment with a low-GWP refrigerant. The US EPA SNAP program lists several low-GWP refrigerant options for vending machines, including R-290, R-600a, or R-744 (GWPs = or less than 1).</p> <p>Avoid or prohibit purchasing models that use R-134a.</p>
<p>ENERGY STAR qualified Office Water Coolers</p> 	<p>ENERGY STAR certified water coolers use about 30 % less energy than conventional models.⁹ Some companies have been switching to low-GWP refrigerants such as R-290 (GWP<1). To find products, visit ClimateFriendlyCooling.com or ask your vendor for refrigerant information and specify your preference for low-GWP refrigerants (GWP <150) in procurement.</p> <p>Avoid or prohibit purchasing models that use R-134a.</p>

⁸ https://www.energystar.gov/products/other/vending_machines

⁹ https://www.energystar.gov/products/other/water_coolers

ENERGY STAR qualified window air conditioners

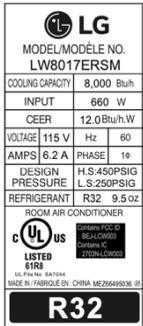

According to the US EPA, “if all window air conditioners sold in the United States were ENERGY STAR certified, the cost savings would grow to more than \$350 million each year, preventing more than 6 billion pounds of greenhouse gas emissions annually, equivalent to the emissions from over 570,000 vehicles”.¹⁰ When purchasing, remember that bigger is not always better! Buying an air conditioner that is too large does not provide better cooling. An oversized air conditioner is actually less effective — and wastes energy at the same time. Make sure your unit is properly sized. Check the product label or specifications (usually available online) to determine what refrigerant the AC unit uses. Choose models with lower-GWP refrigerants like R-32 (GWP 677). R-290 (GWP<1) is also listed by the US EPA’s SNAP program as acceptable for use in window AC units but not larger units.

Avoid or prohibit purchasing models that use R-410A* (GWP=1,924).

To find products, visit [ClimateFriendlyCooling.com](https://www.climatefriendlycooling.com) or select from the Energy Star Most Efficient product list, as these AC units are more likely to use lower-GWP refrigerants like R-32. https://www.energystar.gov/products/most_efficient

*R-410A is a blend of 50% HFC-125 (GWP=3170) and HFC-32 (GWP=677)

Highly efficient mini-split air conditioners or air source heat pumps with lower-GWP refrigerant



Outside of the USA, building space conditioning is largely provided by ductless mini-split air conditioners or air source heat pumps, commonly referred to as “room air conditioners.” An organization called “Top 10” tracks the most efficient models available in international markets. To view efficient models for sale in Europe, for example, go to:

https://www.topten.eu/private/products/air_conditioners


Be sure to check the “product details” tab to find out what refrigerant the AC unit (or heat pump) uses. Lower-GWP options include R-32 (GWP 677), and in some markets outside the United States, R-290 (GWP<1). R-290 is not currently allowed in the USA for most AC equipment. Recently, Daikin, [announced their intent to offer](#) a super-efficient model using low-GWP refrigerant HFO-1234ze (GWP<1), so purchasing officials may have additional options in the future as well.

¹⁰ https://www.energystar.gov/products/heating_cooling/air_conditioning_room/cool_choice_room_ac

<p>Energy efficient vehicles with low-GWP refrigerant</p> 	<p>Vehicle air conditioning systems account for about one-quarter of GWP-weighted HFC emissions. Fortunately, all new light duty vehicles sold in Europe and most new light duty vehicles sold in the USA use low-GWP HFO-1234yf (GWP<1) air conditioners with same or better AC performance and no difference in vehicle price. The news of procurement preference for lower carbon footprint will have a motivating influence on automakers to complete the market transformation.</p> <p>Find updated listings of energy efficient vehicles at: https://www.fueleconomy.gov/feg/best-worst.shtml Note that when considering electric vehicles, the life-cycle climate performance depends on the carbon intensity of your local electricity power supply (typically expressed in grams or pounds of CO₂ per kilowatt-hour). The Union of Concerned Scientists offers a handy tool that allows you to compare electric and gas vehicles based on your zip code: https://evtool.ucsus.org.</p> <p>Ask your supplier what type of refrigerant the car AC uses. If in doubt, the Mobile Air Conditioning Society tracks which models use low-GWP HFO-1234yf versus higher GWP HFC-134a (GWP=1,300): https://macsworldwide.wordpress.com/2019/05/20/finding-yf-2019-refrigerant-update/</p> <p>Specify GWP<150 in procurement documents.</p> <p>Avoid or prohibit purchasing models that use R-134a.</p>
--	---

Figure 2 is a decision-making tool for optimizing energy efficient equipment with low-GWP refrigerants for “self-contained, pre-charged” equipment”, such as refrigerators and room-size air conditioners. This category of equipment includes complete units that have been filled (i.e., charged) with refrigerant by the manufacturer. Refrigerant losses (emissions) during usage are usually minimal, and therefore recharging not necessary. Changing refrigerant (to a low-GWP one, for example) after the equipment is installed is rarely cost effective and could actually be environmentally detrimental due to refrigerant emissions during changeover and possibly lower energy efficiency if components cannot be reoptimized.

FIGURE 2: DECISION TREE

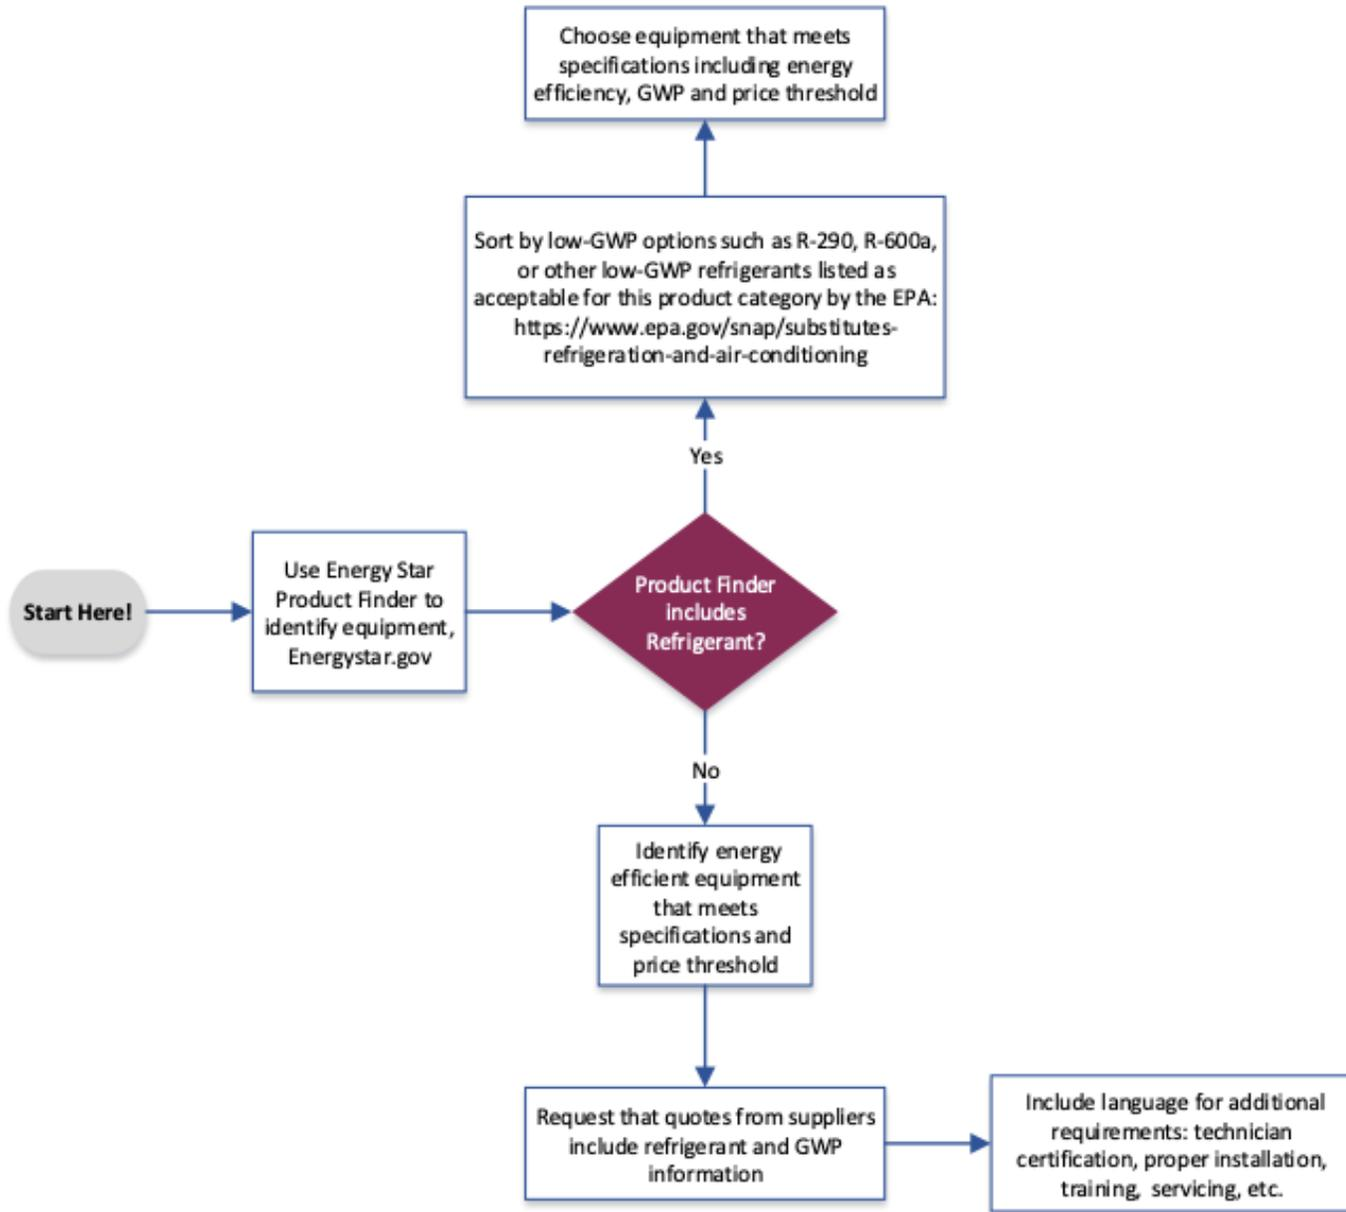

See Specifications (Section 3, page 22) for contract language.

Large refrigeration systems, such as those used in a supermarket, are complex, require more comprehensive reviews of system requirements, and would involve additional internal resources such as facility engineers for decision-making. See Appendix C for decision-making guidance for large refrigeration systems.

For more discussion of maintenance and end-of-life procedures for these products and equipment, please see the Specifications section.

STRATEGY 3: DRIVE THE MARKET

Communicate your new demand for energy efficient products using low-GWP refrigerants to your suppliers, and insist on reclaimed refrigerant from a [certified refrigerant reclaimer](#) to service existing equipment. In some cases, government or other institutional purchasers may help suppliers offer more low-GWP choices by coordinating with state and local authorities to remove barriers. For instance, adopting the latest building codes and standards may help remove outdated requirements and ensure safety when installing newer low-GWP equipment. Adopting ASHRAE 15-2019 into building codes and recognizing UL 60335-2-40 3rd edition, as Washington State has done, can enable the use of lower GWP refrigerants sooner. Collaborate with your suppliers to find creative solutions to any barriers that arise – this can accelerate the transition away from high-GWP HFCs.

By adopting similar organizational policies and aggregating demand that drives equipment costs down, governments and other institutional purchasers send a market signal that may drive market transformation. For example, the government of India recently procured low-GWP room ACs with energy efficiency higher than previously offered at price about 30 percent lower.¹¹ Bulk purchase by large organizations (e.g. government agencies, buyers clubs, or other enterprises) can often result in discounts that help justify the purchase price of new equipment. Purchasers can work with suppliers to negotiate bulk purchase discounts.

STRATEGY 4: INSIST ON PROPER EQUIPMENT CARE WITH RECLAIMED REFRIGERANT AND USE PROPER INSTALLATION TECHNIQUES

Improper equipment installation or maintenance will waste energy, shorten product lifespan, and may pose safety hazards. *Insist on proper installation and system commissioning by qualified professionals.* Support proper installation, commissioning, maintenance, and servicing of air conditioning and refrigeration systems to reduce refrigerant leaks and maintain energy efficiency consistent with Air Conditioning Contractors of America Quality Installation (ACCA QI) standards and original equipment manufacturer instructions. <https://www.acca.org/standards/quality>.

Reduce refrigerant climate impacts of existing equipment by using reclaimed refrigerant wherever possible. Ensure the recovery and reclaim or destruction of all refrigerants at equipment end of life. The U.S. Environmental Protection Agency maintains a list of certified refrigerant reclaimers: <https://www.epa.gov/section608/epa-certified-refrigerant-reclaimers>

Support optimizing existing refrigeration systems by:

- Ensuring refrigerant purchasing records are maintained (see subsection 5 in Specifications for contract language).
- Ensuring installers utilize best practices (see subsection 3 in Specifications for contract language).
- Ensuring internal resources/contractors are compliant with Clean Air Act requirements and EPA regulations.

¹¹ <http://www.igsd.org/igsd-teri-and-nrdc-congratulate-energy-efficiency-services-ltd-eesl-and-voltas-for-affordable-ac-protecting-climate-and-the-ozone-layer/>

Procurement Recommendations for Climate Friendly Refrigerants

- **Stationary refrigeration and air conditioning equipment.** EPA regulations ([40 CFR Part 82, Subpart F](#)) under Section 608 of the [Clean Air Act](#) require proper refrigerant management practices by those who buy or sell refrigerant, technicians, and owners and operators of AC and refrigeration systems. [Technicians](#) who maintain, service, repair, or dispose of equipment that could release refrigerants into the atmosphere must be certified. See the EPA Section 608 Technical Certification Page at <https://www.epa.gov/section608/section-608-technician-certification>. (These requirements apply for all refrigerants that contain ozone-depleting substances, e.g., hydrochlorofluorocarbons (HCFCs), and non-exempt substitute refrigerants, e.g., hydrofluorocarbons (HFCs), hydrofluoroolefins (HFOs) and blends thereof).
- **Motor vehicle air conditioning equipment.** According to the US EPA,¹² “Any person who repairs or services a motor vehicle air conditioning (MVAC) system for consideration (payment or bartering) must be properly trained and certified under section 609 of the Clean Air Act by an EPA-approved program. All technicians servicing MVAC-like appliances must be certified. EPA-approved technician training and certification programs provide education on the proper use of MVAC servicing equipment, the applicable regulatory requirements, the importance of refrigerant recovery, as well as the effects of improper handling of refrigerants on the ozone layer and climate. To be certified, technicians must be trained by an EPA-approved program and pass a test demonstrating their knowledge in these areas.”
 - See the Specifications, Section 3, for sample contract language.
- Considering the adoption of EPA Rule 608 as best practice for all refrigerants, <https://www.epa.gov/section608/revised-section-608-refrigerant-management-regulation>. Not only will this reduce the impacts of refrigerants, material and operational costs will also be reduced due to fewer refrigerant purchases and improved equipment efficiency.¹³

STRATEGY 5: REQUIRE PROPER REFRIGERANT DISPOSAL AND MATERIALS RECYCLING

Ask to see your service professional’s Section 608 (or in the case of vehicles, 609) Certification and refrigerant recovery or recycling equipment, and ask how they dispose of used or contaminated refrigerant. If they hesitate or cannot prove their certification, select a different service professional. Refer to US EPA’s list of Certified Refrigerant Reclaimers for more information, <https://www.epa.gov/section608/epa-certified-refrigerant-reclaimers>. If you have old ozone-depleting refrigerants, you may even be able to get paid for sending them to a company for destruction for carbon credits. Companies like A-gas, ClimeCo., Hudson and Tradewater offer these services. (IGSD and SPLC do not endorse any specific company offering payment for refrigerant destruction, example provided for illustration only.) Unfortunately, in some cases technicians might vent refrigerant to the atmosphere instead of investing in and/or using proper refrigerant recovery or recycling equipment. Refrigerants of various types and from different systems should be separated to ensure they can be properly reclaimed as recommended by the

¹² Source: <https://www.epa.gov/mvac/section-609-technician-training-and-certification-programs>

¹³ During the Obama Administration, EPA sought to promulgate more stringent standards for refrigerants during servicing under Section 608 of the Clean Air Act; these standards were withdrawn by the Trump Administration but as of mid-2021 are expected to be reinstated and potentially expanded by the Biden Administration, particularly given the way the American Innovation and Manufacturing Act expanded EPA’s authority with regard to refrigerant management.

[American Society of Heating, Refrigerating and Air-Conditioning Engineers \(ASHRAE\)](#) and the [United Nations Environmental Programme \(UNEP\) course on Sound Refrigerant Management](#).

If purchasing new appliances, inquire about disposal practices for old appliances to be sure they are not re-sold in markets with poor environmental controls. This is a form of [environmental dumping](#). Instead, consider working with a partner in the US EPA's Responsible Appliance Disposal (RAD) program. RAD is a voluntary partnership program that works with utilities, retailers, manufacturers, state and local government agencies, affiliates, and others to dispose of old refrigerated appliances using the best environmental practices available—going beyond federal requirements to protect Earth's climate and ozone layer: <https://www.epa.gov/rad>. See subsection 4 of Specifications for contract language.

Special opportunities

New or expanding facilities

New facilities or those that are expanding with new construction or remodeling have more technical choices and can capture volume discounts. Specifications for low-GWP refrigerant products can be incorporated into the initial design, reducing potential burden when replacing equipment in existing facilities with technical constraints.

Student housing

Universities can reduce cost, inconvenience, and energy use with bulk procurement of next generation efficient technology in applications such as dorm room mini-refrigerators and/or air conditioners. Efficient low-GWP models with low carbon footprint can help save money, demonstrate concern for the environment, and help satisfy the increasing student demand for climate protection and sustainability. Many new mini-refrigerators use R-600a and do not cost more. Indeed improved efficiency may save universities money.


GOOD TO KNOW: STATES ADOPT POLICIES TO PHASE DOWN HFCS

Over the past few years, a number of US States adopted rules and regulations restricting the use of high GWP HFCs in certain product categories such as refrigeration, air conditioning, and foam insulation. These state laws are consolidated in one place at [HFcbans.com](https://www.hfcbans.com).

The American Innovation and Manufacturing Act passed in December 2020 provides the US EPA with expanded authority to regulate HFCs nationally, but the state laws still apply.

As of August 2021, the US EPA has been petitioned under the American Innovation and Manufacturing Act to adopt national HFC phasedown rules for products to establish market certainty and a level playing field for manufacturers producing products that currently or formerly used high GWP HFCs.

FIGURE 4: STATES THAT HAVE IMPLEMENTED (GREEN) OR PROPOSED (LIGHT BLUE) HFC RESTRICTIONS BASED ON SNAP RULES 20 AND 21 as of summer 2021.
 MAP CREDIT: Institute for Governance & Sustainable Development.

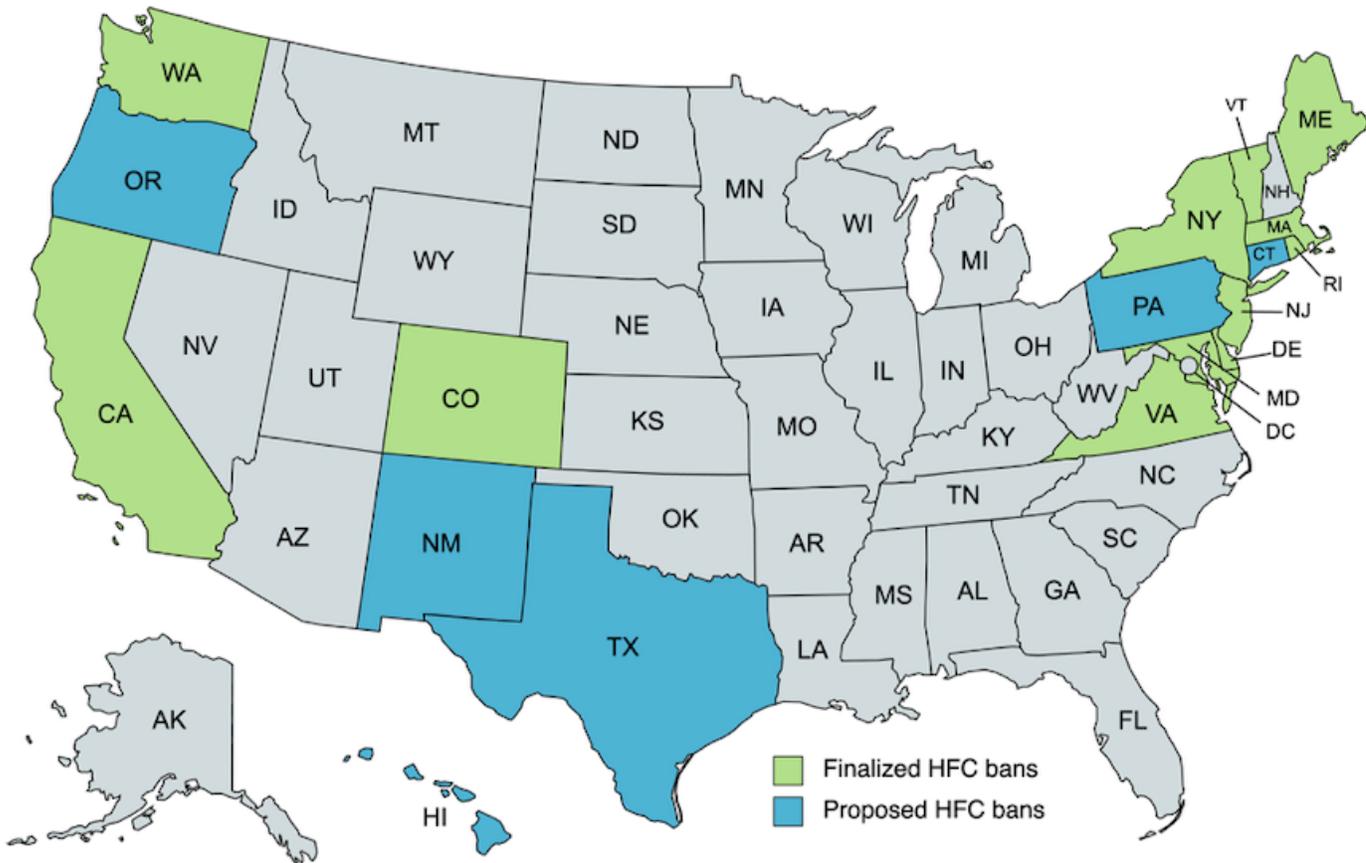

3. SPECIFICATIONS

Use the following specifications in contracts for equipment that uses refrigerants.

1. Purchase of New Equipment and Products

Vendor shall provide equipment containing low GWP substitutes approved under United States Environmental Protection Agency’s Significant New Alternative Policy (SNAP) program and permissible under state regulations.

Vendors shall provide products with a lower GWP, to the maximum extent practicable where such products are cost-effective (using life cycle-climate performance (LCCP)) and meet form, function, and utility requirements.

- Qualifying products for most categories (e.g. refrigerators, freezers, stand-alone retail food refrigeration equipment, room/window AC units, water coolers, lab-grade refrigerators, and freezers) may be found through the ENERGY STAR [Product](#)

Procurement Recommendations for Climate Friendly Refrigerants

[Finder or at ClimateFriendlyCooling.com](#) for more information, please refer to Section 2: Take Action

- SNAP’s acceptable refrigerants by end-use can be found at <https://www.epa.gov/snap/snap-substitutes-sector>
- Substitutions can be filtered by Retrofit or New, and sorted by GWP: <https://www.epa.gov/snap/snap-substitutes-sector>
- HFC prohibitions by state and product category can be found here: www.HFCbans.com
- For information specific to alternatives used for retrofitting systems, please contact your equipment manufacturer.

2. New Equipment Installations

Vendor shall ensure technicians who install air conditioning equipment follow original equipment manufacturer instructions, industry-wide best practices, and when applicable, the Quality Installation standards issued by the Air Conditioning Contractors of America (<https://www.acca.org/standards/quality>). Best practices include optimizing charge size and choosing appropriate capacity for the intended operation.

Vendors installing new refrigerators, freezers, or other appliances and removing old appliances shall certify that old products are properly recovered and reclaimed or disposed of, with refrigerants and/or insulation containing high-GWP chemicals or ozone-depleting substances properly recovered and recycled. See the EPA Responsible Appliance Disposal program for guidance: <https://www.epa.gov/rad>

3. Preventative Maintenance, Service, and Repair for New and Existing Equipment

Preference for reclaimed refrigerants

Contractors shall use reclaimed refrigerant to service existing equipment and provide proof of purchase from a certified reclaimer (or one of their distributors). In the USA, the Environmental Protection Agency maintains a list of certified refrigerant reclaimers: <https://www.epa.gov/section608/epa-certified-refrigerant-reclaimers>

AC systems & equipment - Technician Certification & Refrigerant Recovery Requirements

Contractors shall demonstrate that they have the proper certifications and refrigerant recovery and recycling equipment prior to performing work. Pursuant to EPA regulations found in 40 CFR Part 82, Subpart F, technicians who maintain, service, or repair of equipment that may release refrigerants must possess the Section 608 Technician Certification. Vendors are encouraged to use certified reclaimed refrigerant for routine servicing, maintenance or repair.

Commercial Refrigeration Systems (if applicable) To ensure energy efficient operations are optimized and refrigerant emissions are reduced, Vendor shall ensure that technicians follow best practices for all preventative maintenance checks, servicing, and repairs. Technicians shall perform regular leak prevention checks at a schedule appropriate for the equipment end-use and determined by the [Organization] or as required by law.*

Procurement Recommendations for Climate Friendly Refrigerants

- US EPA's GreenChill provides best practices for [Refrigerant Leak Prevention through Regular Maintenance](#) and [Commercial Refrigeration Leak Prevention & Repair](#).
- Food retailers may also wish to download "[A Practical Guide to Refrigerant Regulations for Food Retailers](#)" published by the Ratio Institute in September 2021

Vendor shall ensure HFC and HFC blend refrigerants are captured and reclaimed from existing equipment to reduce the production of new HFCs.

** Reporting requirements may vary on a state-by-state basis. Please review your state's guidelines. Also note that high-GWP refrigerants may have stricter reporting requirements than low-GWP refrigerants.*

4. End-of-Life Management

Pursuant to Section 608 of the Clean Air Act, ozone-depleting substance (ODS) and HFC refrigerants may not be vented from appliances.*

Under EPA regulations at [40 CFR Part 82, Subpart F](#), technicians who dispose of equipment that may release refrigerants must possess [608 Technician Certification](#). Technicians disposing of a motor vehicle air conditioning (MVAC) system must possess the [Section 609 Technician Certification](#).

In accordance with Section 608 of the Clean Air Act, refrigerant recovery and recycling equipment must meet the requirements set forth in [Appendix B2, B3, and B4 to 40 CFR 82, Subpart F](#).

For small appliances (e.g., refrigerators, window AC units) refrigerants can be recovered by a technician, appliance recycling facility, or through the vendor supplying the replacement appliance. Small appliances may be disposed of through the Responsible Appliance Disposal (RAD) program referenced below.

Vendor shall ensure that evidence of equipment's proper disposal can be provided.

- Vendor is encouraged to recycle old appliances using a Partner in the US EPA's [Responsible Appliance Disposal \(RAD\) program](#). Partners in the RAD program go beyond federal requirements by responsibly recycling equipment using the best environmental practices available. Recycling facilities servicing RAD partners can be found [here](#).
- The RAD Program also provides [Example Language for Procuring Refrigerated Appliance Recycling Services Using Best Environmental Practices](#).
- Vendor is encouraged to consider becoming a Partner - or an Affiliate (as appropriate) in the EPA's RAD program.

**Please note that R-600A (isobutane) R-441A (a blend of ethane, propane, n-butane and isobutane) in household refrigerators, freezers, and combination refrigerators and freezers, and R-290 (propane) in retail food refrigerators and freezers (stand-alone units only) are exempt from the venting prohibition because EPA has determined that their emissions do not pose a threat to the environment. These refrigerants have short atmospheric lifetime and very low global warming potential.*

[\[https://www.regulations.gov/document?D=EPA-HQ-OAR-2012-0580-0036\]](https://www.regulations.gov/document?D=EPA-HQ-OAR-2012-0580-0036)

5. Tracking and Reporting

Vendor shall require contractors or technicians to track and report on the amounts of refrigerants, including HFCs and HFC blends, added or removed during routine installation, maintenance, service, repair, and disposal of all equipment, appliances, and supplies.

APPENDIX A: WHAT ARE HFCs AND WHY ARE THEY BEING PHASED DOWN?

HFCs were developed to rapidly replace a portion of the ozone-depleting substances (ODSs) such as CFCs and HCFCs that were phased out under the *Montreal Protocol*. ODSs catalytically destroy the stratospheric ozone layer which protects Earth against the harmful effects of ultraviolet radiation including skin cancer, cataracts, suppression of the human immune system, and damage to agricultural and natural ecosystems. HFCs are safe for the ozone layer and are typically less damaging to climate than CFCs and HCFCs, but are nevertheless too damaging to be sustainable with GWP up to almost 10,000 times greater than CO₂.¹⁴

Fortunately, high-efficiency, lower-GWP replacement technology is available or under development for most sectors. See [ClimateFriendlyCooling.com](https://www.climatefriendlycooling.com) for examples.

COST SAVINGS

Many energy efficient products using low-GWP refrigerants are available at equal or lower costs than comparable products using high-GWP refrigerants. See **Table 1: How to find Commercially Available Energy Efficient Products that use Low GWP Refrigerants**. There is no discernible difference in consumer prices for these products compared to products that use high-GWP refrigerants.

With the passage of EPA [Significant New Alternatives Policy \(SNAP\) Program Rule 23](#) in May of 2021, larger residential and commercial heat pumps and air conditioning systems will begin transitioning to lower GWP refrigerants. California initially proposed [restricting the sale of these products starting in January 2023](#) if they contain refrigerants with a GWP higher than 750, but delayed the prohibition until January 1st, 2025 in order to provide additional time to code authorities to update to the latest building, mechanical, and fire protection codes.

On November 9, 2018, JMS Consulting and Inforum published a study on “[The Consumer Cost Impacts of US Ratification of the Kigali Amendment](#),” sponsored by the Air Conditioning, Heating and Refrigeration Institute (AHRI) and the Alliance for Responsible Atmospheric Policy. This report analyzed the ownership cost impacts of switching to low-GWP air conditioning refrigerants residential and commercial air conditioning. See Figures 5 and 6 below. The report found that energy consumption is understandably the dominant contribution to consumer costs, at 66 percent of lifetime cost for residential air conditioning and 90 percent for commercial equipment. Refrigerant costs over the lifetime are only 0.7 percent of lifetime costs for residential and 0.4 percent for commercial equipment.¹⁵ Improvements in energy efficiency more than offset the small added cost of superior refrigerant.

¹⁴ GWP is referenced to CO₂, which has a GWP of 1

¹⁵ <https://www.documentcloud.org/documents/5205002-Consumer-Costs-Final-InforumJMS-20181109.html>

FIGURE 5: CONSUMER LIFE CYCLE OWNERSHIP COSTS FOR A REPRESENTATIVE 15 TON COMMERCIAL AC UNIT.


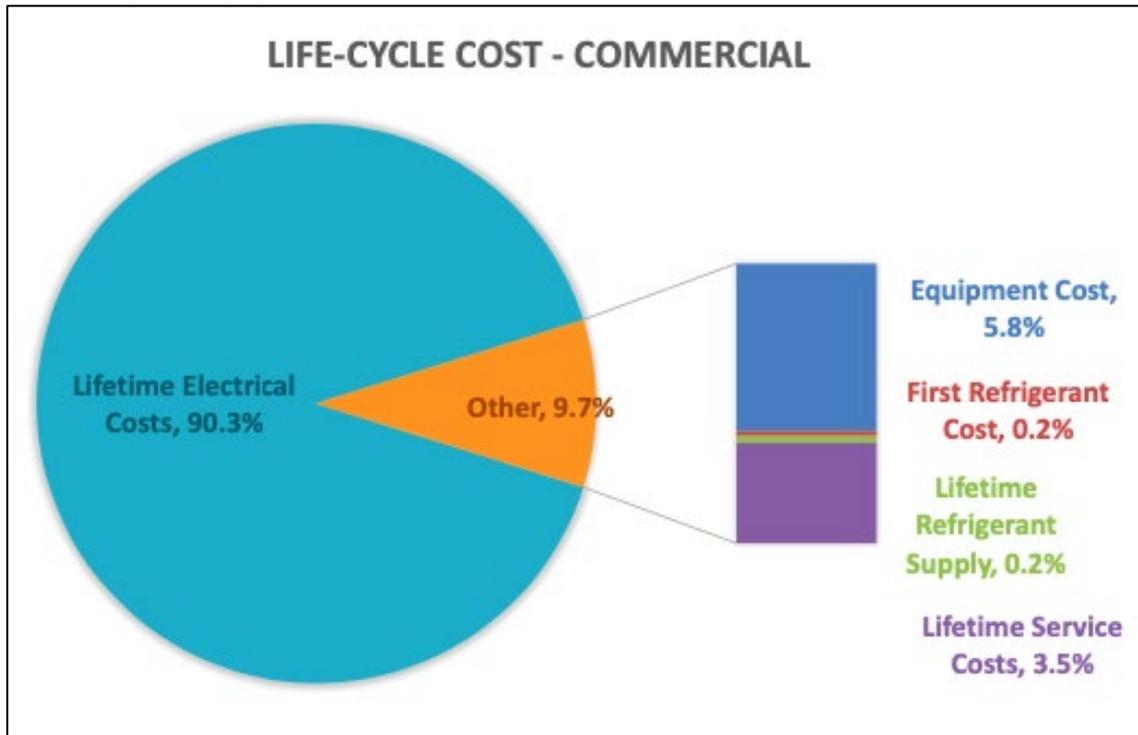


FIGURE 6: CONSUMER OWNERSHIP COSTS FOR A REPRESENTATIVE 2.5 TON RESIDENTIAL OR SMALL COMMERCIAL AC UNIT.

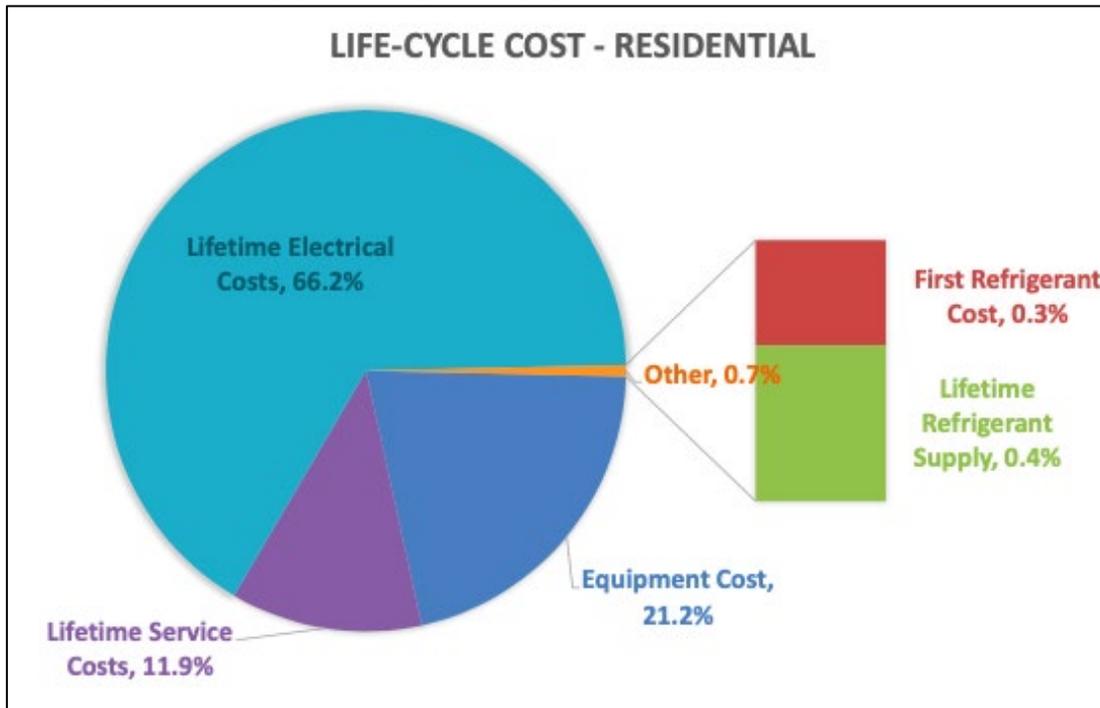


The report authors concluded that:

“With reasonable expectations about the development of the market, in scenarios assuming U.S. ratification of Kigali compared to assuming no adoption in the U.S., total lifetime ownership costs are very similar, with consumer savings in the ‘with Kigali’ case. Although there is no reason to expect that refrigerant prices will behave differently during the Kigali transition than during the two previous transitions away from ozone-depleting substances, even assuming a five-times higher price for replacement refrigerants would not significantly change the impact on consumers.”...”The consumer savings identified in this report cover only two of the largest industry segments. There are over 60 use segments that could be analyzed using more detailed models, such as EPA’s Vintaging Model, as a basis. There are likely benefits elsewhere in HVACR as well as in other industries. A qualitative review of several smaller manufacturing segments supports the expectation of at least small consumer savings in several applications. For several segments there is also an underlying trend of reduced real consumer prices over time through previous transitions.”

Figure 7 below shows real price indices for refrigerators, room AC, and residential central AC (CAC) along with other appliance categories, and industry’s expectations of future costs. Note that costs are expected to continue to decrease.

FIGURE 7: HISTORICAL & PROJECTED REAL PRICE INDICES FOR U.S. MAJOR APPLIANCE CATEGORIES

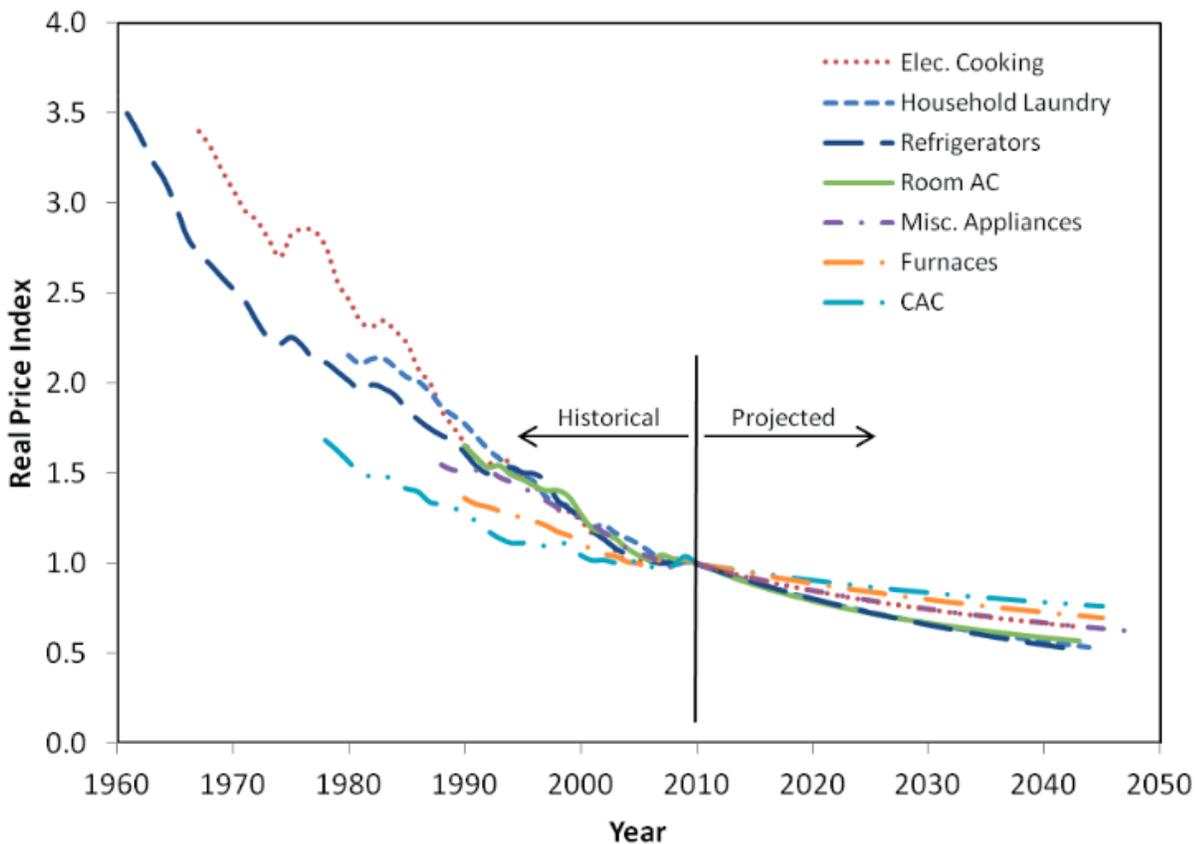

APPENDIX B: CHARACTERISTICS OF COMMON REFRIGERANTS

Table B1 provides the GWP of chemicals commonly used as refrigerants, or as components in refrigerant blends. The World Meteorological Organization's 2018 numbers reflect the latest science on warming impacts. Many government sources continue to cite the Intergovernmental Panel on Climate Change's 4th Assessment Report (AR4) 100-year GWP values. Some organizations and state governments prefer to cite the IPCC's more recent 5th Assessment Report, and/or use the 20-year GWPs for HFCs given their short atmospheric lifetimes. A complete list of chemicals and their associated GWPs can be found in Chapter 8, Appendix 8.A of Climate Change 2013: The Physical Science Basis: Contribution of Working Group I to the Fifth Assessment Report of the Intergovernmental Panel on Climate Change.¹⁶

TABLE B1: GLOBAL WARMING POTENTIAL OF SOME COMMON REFRIGERANTS

Substance / Industrial designation or chemical name	Total Lifetime (years) (WMO 2018)	GWP-100 (WMO 2018)	GWP-100 (IPCC AR5*)	GWP-20 (IPCC AR5*)
Hydrocarbons (not ozone depleting, negligible GWPs)				
HC-290 (propane)	0.4 days	<1	<1*	<1*
HC-600a (isobutane)	0.2 days	<<1	<1*	<1*
HC-1270 (propylene)		<<1	<1*	<1*
Hydrochlorofluorocarbons (ozone depleting, globally eliminated in new equipment, but still present in existing equipment)				
HCFC-22	11.9	1780	1760	5280
HCFC-123	1.3	80	79	292
Hydrofluorocarbons (not ozone depleting, some have significant climate impacts)				
HFC-23 (HFC-23 is a byproduct of HCFC-22 production. HCFC-22 used as a feedstock to make Teflon)	228	12690	12400	
HFC-32	5.4	704	677	2430
HFC-125	30	3450	3170	6090
HFC-134a	14	1360	1300	3710
HFC-143a	51	5080	4800	6940
HFC-152a	1.6	148	138	506

¹⁶ https://www.ipcc.ch/site/assets/uploads/2018/02/WG1AR5_Chapter08_FINAL.pdf

Unsaturated Hydrofluorocarbons (not ozone depleting, negligible GWPs)				
HFO-1234yf	12 days	<1	<1*	<1*
HFO-1234ze(E)	19 days	<1	<1*	<1*
HFO-1336mzz(Z)	122 days	2	16*	60*
HCFO-1233zd(E)**	26 days	1	NA	N/A
Other refrigerants (not ozone depleting, negligible GWPs)				
R-744 (carbon dioxide)	Thousands of years	1	1	1
R-717 (ammonia)	Days	<1	<1*	NA

*GWPs for HFO-1234yf, HFO-1234ze(E), and HFO-1336mzz(Z) and ammonia from WMO 2018:

<http://conf.montreal-protocol.org/meeting/oewg/oewg-41/presession/Background-Documents/SAP-2018-Assessment-report.pdf>.

**GWP and atmospheric life for R-1233zd(E) are from: http://conf.montreal-protocol.org/meeting/oewg/oewg-39/presession/Japan_submissions/JRAIA-Symposium2016_0804_centrifugal_chiller_E.pdf

In addition to considering refrigerant GWPs and impact on the stratospheric ozone layer, the US Environmental Protection Agency's Significant New Alternatives Policy (SNAP) program, safety professionals, and industry organizations such as ASHRAE (American Society of Heating Refrigeration and Air Conditioning Engineers) and SAE (Society of Automotive Engineers) evaluate refrigerants' toxicity, flammability, and other characteristics, and set appropriate standards and use restrictions to assure that risks are properly mitigated. Some of these characteristics are included in Table B2.

Procurement Recommendations for Climate Friendly Refrigerants

TABLE B2: CHARACTERISTICS OF REFRIGERANTS

Substance / Industrial designation or chemical name	ASHRAE toxicity*	ASHRAE flammability**	TFA***
Hydrocarbons			
HC-290 (propane)	A	3	No
HC-600a (isobutane)	A	3	No
HC-1270 (propylene)	A	3	No
Hydrochlorofluorocarbons			
HCFC-22	A	1	
HCFC-123	A	1	
Hydrofluorocarbons			
HFC-32	A	2	No
HFC-125	A	1	
HFC-134a	A	1	Yes
HFC-143a	A	2L	Yes
HFC-152a	A	2	No
Unsaturated Hydrofluorocarbons			
HFO-1234yf	A	2L	Yes
HFO-1234ze(E)	A	2L	Some (<10%)
HCFO-1224yd(Z)	A	1	Yes
HFO-1336mzz(Z)	A	1	Some (<20%)
HCFO-1233zd(E)	A	1	No
Other refrigerants			
R-744 (carbon dioxide)	A	1	No
R-717 (ammonia)	B	2L	No
R-718 (water)	A	1	No

*ASHRAE categorizes refrigerants into 2 toxicity classes: A (lower toxicity) and B (higher toxicity).

**ASHRAE categorizes refrigerants into 4 flammability classes: 1 (generally nonflammable), 2L (very low flammability—some have likened it to olive oil), 2 (lower flammability), and 3 (higher flammability). See the United

Procurement Recommendations for Climate Friendly Refrigerants

Nations-ASHRAE 2019 fact sheet, "Update on New Refrigerant Designations and Safety Classifications."

https://www.ashrae.org/File%20Library/Professional%20Development/Factsheet_ASHRAE_English_20190118.pdf.

***Trifluoroacetic acid (TFA) is an atmospheric break-down product of certain fluorinated refrigerants, such as HFO-1234yf. TFA is an emerging concern to some in the scientific community. Learn more from the United Nations Environment Programme at: <https://ozone.unep.org/sites/default/files/2019-08/TFA2016.pdf>. (The UNEP link references the following paper: Solomon K, Velders G, Wilson S, Madronich S, Longstreth J, Aucamp P, Bornman J. 2016. *Sources, fates, toxicity, and risks of trifluoroacetic acid and its salts: Relevance to substances regulated under the Montreal and Kyoto protocols*. Journal of Toxicology and Environmental Health B. This report is an Accepted Manuscript of an article published by Taylor & Francis in J Toxicol Environ Hlth B on June 27, 2016. The paper is also available online at: <http://www.tandfonline.com/10.1080/10937404.2016.1175981>.) See also: <https://www.epeglobal.org/wp-content/uploads/2018-11-06-QA-Screen.pdf>

APPENDIX C: LARGER EQUIPMENT

Larger systems that require HFCs are complex and require a level of technical expertise that is generally outside of the scope for procurement professionals. Decisions concerning these types of equipment should be made by engineers, facilities managers, and others with the appropriate training. Appendix B contains information that may be useful in understanding these systems and making appropriate procurement decisions.

Performance Criteria For Refrigeration Systems

There are three types of performance criteria that apply to selection of refrigeration and air conditioning equipment:

1. Technical Performance, including cooling capacity (measured in TONs, BTUs, etc.), energy efficiency (measured as Energy Efficiency Ratio (EER), Coefficient of Performance (COP), Seasonal Energy Efficiency Rating (SEER), etc.), and reliability (lubricant and materials compatibility, duty cycles);
2. Life Cycle Climate Performance—LCCP or life cycle carbon footprint (measured on a product life cycle basis including—on a carbon-equivalent basis—direct GHG refrigerant emissions, indirect fossil fuel or biomass emissions for electricity consumption and embodied emissions from manufacture, transport, and recycle at end of product life).
3. Life Cycle Financial Ownership Cost including the cost of purchase, transport, installation, maintenance, operation, and retirement (recycle of material, recovery and reuse or destruction of ozone-depleting or GHG refrigerants).

Procurement officials can customize their purchase performance criteria requirements based on their individual needs.

LARGE SUPERMARKET REFRIGERATION SYSTEMS

According to the US EPA, most of the 35,000+ supermarkets in the United States use centralized direct expansion (DX) systems to chill their products.¹⁷ Typically, these refrigeration systems are charged with 3000 – 4000 pounds of refrigerant and can leak more than 20% of their charge each year. Commonly used refrigerants include ozone-depleting HCFC refrigerants, often HCFC-22 (GWP=1,760), and blends consisting entirely or primarily of HFCs, both of which are potent greenhouse gases. Fortunately, in recent years there have been several advancements in refrigeration technology that can help food retailers reduce both refrigerant charges and refrigerant emissions. Refrigerants such as CO₂, ammonia, hydrocarbons, and HFOs have potential to be used in commercial refrigeration systems in the U.S. market. Currently CO₂ is being used as a primary refrigerant in commercial refrigeration system applications in the United States. Refrigeration systems that use CO₂ as a primary refrigerant are commonly referred to as transcritical CO₂ systems. Transcritical CO₂ refrigeration is a type of

¹⁷ See: <https://www.epa.gov/greenchill/advanced-refrigeration>

Procurement Recommendations for Climate Friendly Refrigerants

refrigeration cycle in which CO₂ is the sole refrigerant, evaporating in the subcritical region and rejecting heat at temperatures above the critical point in a gas cooler instead of a condenser. Recent demonstration projects for utilizing low-GWP alternatives to HFCs presented by the CCAC calculated energy savings of 15 percent to 30 percent and carbon footprint reductions of 60 percent to 85 percent for refrigeration in commercial food stores.¹⁸ For more information on acceptable low-GWP refrigerants, see [Acceptable Substitutes in Retail Food Refrigeration](#) at www.epa.gov/snap. Note that smaller stand-alone commercial refrigeration equipment often uses climate friendly R-290 refrigerant. A list of hundreds of Energy Star qualified commercial stand-alone refrigerators and freezers that use lower-GWP refrigerants is available at ClimateFriendlyCooling.com

One of the best ways for supermarkets to learn about how to reduce refrigerant emissions and decrease their impact on the environment is through the EPA's GreenChill partnership program. GreenChill works to help food retailers transition to environmentally friendlier refrigerants; lower refrigerant charge sizes and eliminate leaks; and adopt green refrigeration technologies and best environmental practices. GreenChill's Store Certification Program for Food Retailers recognizes individual stores for using environmentally friendlier commercial refrigeration systems. While GreenChill does not require low-GWP refrigerants to earn the certification, using low-GWP refrigerants is one pathway to earn the Platinum- level certification. Learn more at: <https://www.epa.gov/greenchill>.

Food retailers may also wish to download "[A Practical Guide to Refrigerant Regulations for Food Retailers](#)" published by the Ratio Institute in September 2021.

LARGE INDUSTRIAL REFRIGERATION SYSTEMS

While most procurement officials are unlikely to be purchasing large industrial refrigeration systems, SPLC members may wish to note that large industrial refrigeration systems using low-GWP options have been the industry norm for over a century. According to the Refrigeration, Air Conditioning and Heat Pumps Technical Options Committee (RTOC) of the Montreal Protocol's Technology and Economic Assessment Panel,

"Industrial refrigeration systems are used in a wide range of applications globally, applying a variety of refrigerants and technologies for a wide range of temperature levels. In larger industrial refrigeration plants, R-717 (ammonia, GWP=0) has been extensively used for more than 150 years. Current technological advances enable the use of low charge R-717 systems, as well as cascade systems using R-717 together with R-744 (carbon dioxide, GWP=1) opening up new opportunities... The industry has learned to work safely with R-717 by proper education and training. Accidents are less likely to happen when safety procedures are followed."

Additionally, the Montreal Protocol RTOC notes that "Large size heat pumps are gaining market acceptance due to increased knowledge of the relevant technology benefits. There are several industrial processes where cooling and heating are needed at the same time, for example the

¹⁸ UNEP/Climate and Clean Air Coalition (CCAC) (2014). [Low-GWP Alternatives in Commercial Refrigeration: Propane, CO₂ and HFO Case Studies](#).

Procurement Recommendations for Climate Friendly Refrigerants

dairy industry. These cases demonstrate how to fully use the potential of cooling and heating capabilities of heat pumps simultaneously.”¹⁹

MEDIUM-TO-LARGER RESIDENTIAL AND COMMERCIAL AIR CONDITIONERS AND HEAT PUMPS

This category includes equipment that cools enclosed spaces in households and commercial industries, such as central air conditioners (i.e., ducted); packaged rooftop units; water-source and ground-source heat pumps; and other products. It excludes small systems (room air conditioning such as window units, ductless mini split air source heat pumps, or packaged terminal air conditioners commonly found in motel rooms) and very large systems (chillers). Residential and light commercial air conditioning and heat pumps are often distinguished from chillers by the fact that they condition the air directly, rather than cool (or heat) water that is then used to condition air.

In May of 2021, the US Environmental Protection Agency [finalized a new rule](#) (SNAP rule 23) listing lower-GWP refrigerant R-32 (HFC-32, which has a 100-year GWP of about 700) as acceptable in residential and light commercial heat pumps and central AC systems. This will allow customers in the USA to use air source heat pumps and AC systems with lower-GWP refrigerants. All of the air source ACs and heat pumps listed by TopTen EU use lower-GWP R-32: https://www.topten.eu/private/products/air_conditioners

Note that after January 1st, 2025, it will become illegal to install new air conditioners and heat pumps in some states such as California and Washington if they have refrigerants that have a 100-year GWP above 750 according to the 4th Assessment Report of the Intergovernmental Panel on Climate Change. Under these rules, R-32 would be acceptable. Other new low-GWP refrigerants are expected to be introduced in the near future.

In 2021, the American Heating and Refrigeration Institute (AHRI) [petitioned](#) the US Environmental Protection Agency to expand this prohibition nationwide to provide market certainty for US and other manufacturers.

LARGE COMMERCIAL OR INDUSTRIAL AIR CONDITIONING SYSTEMS (CHILLERS)

Chillers typically cool water, which is then circulated to provide comfort cooling throughout a building or other location. Chillers can be classified by compressor type, including centrifugal and positive displacement. Replacing or specifying a chiller for new construction is a major project, generally involving many stakeholders in addition to the procurement official. The US EPA has listed several low-GWP refrigerants as acceptable for use in chillers, including water/lithium bromide absorption, R-744 (CO₂), and several newer refrigerants with GWPs <10, including HFO-1234ze, brand name Solstice® 1234ze and HFO-1336mzz(Z) ((Z)-1,1,1,4,4,4-hexafluorobut-2-ene), brand name Opteon® MZ. Medium-GWP refrigerants listed as acceptable include R-513A (GWP=572), which is a blend of 56% HFO-1234yf and 44% HFC-134a. Learn more at: <https://www.epa.gov/snap/substitutes-centrifugal-chillers>.

¹⁹ See the RTOC report at: https://ozone.unep.org/sites/default/files/2019-04/RTOC-assessment-report-2018_0.pdf

Procurement Recommendations for Climate Friendly Refrigerants

In 2020, major manufacturers have announced the availability of super efficient chillers that utilize low-GWP refrigerants. For example, in early 2020, Daikin announced brand new chiller technology centered on centrifugal products that use new HFO refrigerants. According to Air Conditioning Heating and Refrigeration News, “The new products, the Aptitude™ oil bearing centrifugal chiller and Magnitude® magnetic bearing centrifugal chiller, both utilize R-1233zd. They are both ultra-high efficiency (as low as 0.49 kW/ton at full load operation and part-load values as low as 0.29 kW/ton) and will be available this year.”²⁰

²⁰ <https://www.achrnews.com/articles/142723-daikin-applied-introduces-new-rooftop-and-chillers>

APPENDIX D: TOOLS, RESOURCES, CERTIFICATIONS & PRODUCT LISTS

For purchasers seeking energy efficient, low-GWP products, below are some additional resources.

Certifications and Standards

Demand products and services with third-party, multi-attribute, environmental and quality certifications. The certifications below do not currently mandate the use of low-GWP refrigerants. You will need to seek out low-GWP options that also meet these certifications or guidelines. For guidance on how to locate low-GWP options, see Table 1, How to find Commercially Available Energy Efficient Products that use Low-GWP Refrigerants.



ENERGY STAR OR THE ENERGY STAR MOST EFFICIENT STANDARD

This certification verifies energy efficiency of appliances and equipment. It is a multi-attribute, third party verified certification.



ENERGY STAR also lists “ENERGY STAR Most Efficient” products, which indicate energy efficiencies greater than comparable products with a conventional ENERGY STAR label. ENERGY STAR Most Efficient is a distinction recognizing products that deliver cutting edge energy efficiency along with the latest in

technological innovation. Learn more at [EnergyStar.gov](https://www.energystar.gov)

GREENCHILL CERTIFICATION

GreenChill is an EPA partnership with food retailers to reduce refrigerant emissions and decrease their impact on the ozone layer and climate change. GreenChill’s Store Certification Program for Food Retailers recognizes individual stores for using environmentally friendlier commercial refrigeration systems. A food retail store can achieve Platinum-, Gold-, or Silver-level certification. Any food retail store in the United States, whether in the design phase, remodel phase, newly constructed, or fully operational, can apply for GreenChill’s Store Certification Award. The process is free. While GreenChill does not require low-GWP refrigerants to earn the certification, using low-GWP refrigerants is one pathway to earn the Platinum-level certification. Learn more at:



<https://www.epa.gov/greenchill>.

AIR CONDITIONING CONTRACTORS OF AMERICA (ACCA) QUALITY STANDARDS

Quality Standards describe the procedures that contractors should follow when designing, installing, maintaining, repairing, and verifying indoor environment systems. ACCA’s ANSI-approved quality standards have been adopted by utilities, government agencies, manufacturers and others nationwide. and are freely available. Learn more at:

<https://www.acca.org/standards/quality>.

CERTIFIED REFRIGERANT RECLAIMERS

Using reclaimed refrigerant is a great way to minimize environmental harm of higher GWP refrigerants used by existing equipment. Consider mandating that your organization and its service contractors use reclaimed refrigerant. The US EPA maintains a list of certified refrigerant reclaimers at: <https://www.epa.gov/section608/epa-certified-refrigerant-reclaimers>

AHRI CERTIFIED PRODUCTS

(Air Conditioning, Heating and Refrigeration Institute) certifies product performance and their database also lists ENERGY STAR certified products. The directory is available at: <https://www.ahridirectory.org/>.



SECTION 608 CERTIFICATION FOR STATIONARY AIR CONDITIONING AND REFRIGERATION TECHNICIANS

EPA regulations ([40 CFR Part 82, Subpart F](#)) under Section 608 of the [Clean Air Act](#) require that [technicians](#) who maintain, service, repair, or dispose of equipment that could release ozone depleting refrigerants into the atmosphere must be certified. Starting on January 1, 2018, this requirement has applied to appliances containing most substitute refrigerants, including HFCs.

SECTION 609 CERTIFICATION FOR MOTOR VEHICLE AIR CONDITIONING TECHNICIANS

According to the US EPA, “Any person who repairs or services a motor vehicle air conditioning (MVAC) system for consideration (payment or bartering) must be properly trained and certified under section 609 of the Clean Air Act by an EPA-approved program. All technicians servicing MVAC-like appliances must be certified.

EPA-approved technician training and certification programs provide education on the proper use of MVAC servicing equipment, the applicable regulatory requirements, the importance of refrigerant recovery, as well as the effects of improper handling of refrigerants on the ozone layer and climate. To be certified, technicians must be trained by an EPA-approved program and pass a test demonstrating their knowledge in these areas.”²¹ On the left is an example of the certificate provided [by the Mobile Air Conditioning Society Worldwide](#). Learn more at: <https://www.epa.gov/mvac/section-609-technician-training-and-certification-programs>



²¹ <https://www.epa.gov/mvac/section-609-technician-training-and-certification-programs>

Product Lists

[ClimateFriendlyCooling.com](https://www.climatefriendlycooling.com) has lists of energy efficient products available for purchase in North America that use low-GWP refrigerants. Products covered include:

- Refrigerators
- Freezers
- Vending machines
- Commercial refrigerators
- Commercial ice makers
- Lab-grade refrigerators and freezers
- Air conditioners
- Dehumidifiers
- Vehicle air conditioners

The most complete US product lists to date of energy efficient refrigeration and air conditioning equipment can be found at the ENERGY STAR, AHRI, and EIA websites:

ENERGY STAR Product Finder: <https://www.energystar.gov/productfinder/>

EIA Buyers Guide for HFC-free Refrigerators: <https://eia-global.org/reports/20200625-hfc-free-refrigerator-list>

AHRI directory: <https://www.ahridirectory.org/Search/SearchHome?ReturnUrl=%2f>

(Note: Energy Star and the Consortium for Energy Efficiency, a utility program partnership, pull from the AHRI directory listings for their energy efficiency product lists:

<http://www.ceedirectory.org>)

AHRI is considering updating its directory to include refrigerant and has noted that if a sufficient number of customers or states request this update, they will gladly add it. ENERGY STAR currently lists refrigerant for some, but not all, product categories.

Outside of the USA, TopTen is an excellent resource for lists of energy efficient products that use low-GWP refrigerants. To view efficient models for sale in Europe, for example, go to:

https://www.topten.eu/private/products/air_conditioners. Be sure to check the “product details” tab to find out what refrigerant the AC unit (or heat pump) uses.


APPENDIX E: DETAILS OF THE MONTREAL PROTOCOL ON SUBSTANCES THAT DEplete THE OZONE LAYER AND THE 2016 KIGALI AMENDMENT

The climate protection legacy of the Montreal Protocol continues: The legally binding 2016 Kigali Amendment to the Protocol phasing down HFCs, could prevent up to an additional 0.5 degrees Celsius of global warming by the end of this century (see Figures 1 and 2). As of August 2021, more than 120 countries have ratified or otherwise adopted the Kigali Amendment, including China and India. The United States has a domestic law binding the USA to the same HFC reduction targets but had not yet formally ratified the treaty as of August 2021. For status of countries that have ratified the Kigali Amendment, please visit <https://ozone.unep.org/all-ratifications>.

However, achieving those ambitious climate protection targets depends on sustainable procurement policies that encourage manufacturers and end-users to make choices that improve products' life-cycle climate performance, taking into account not only direct emissions (refrigerant GWP), but also indirect emissions (energy related emissions). Energy use can account for 80 percent or more of the climate impact of an air conditioner depending on electricity GHG intensity.

This has led some policymakers to use the 20-year GWP when evaluating HFCs, instead of the 100-year GWPs. A table with both the 100-year and 20-year GWPs associated with common HFCs is included in Appendix C, under "characteristics of common refrigerants."


FIGURE 1: HFC EMISSIONS AND THE CONTRIBUTION OF HFCs TO THE GLOBAL AVERAGE SURFACE WARMING OF EARTH WITH AND WITHOUT THE KIGALI AMENDMENT

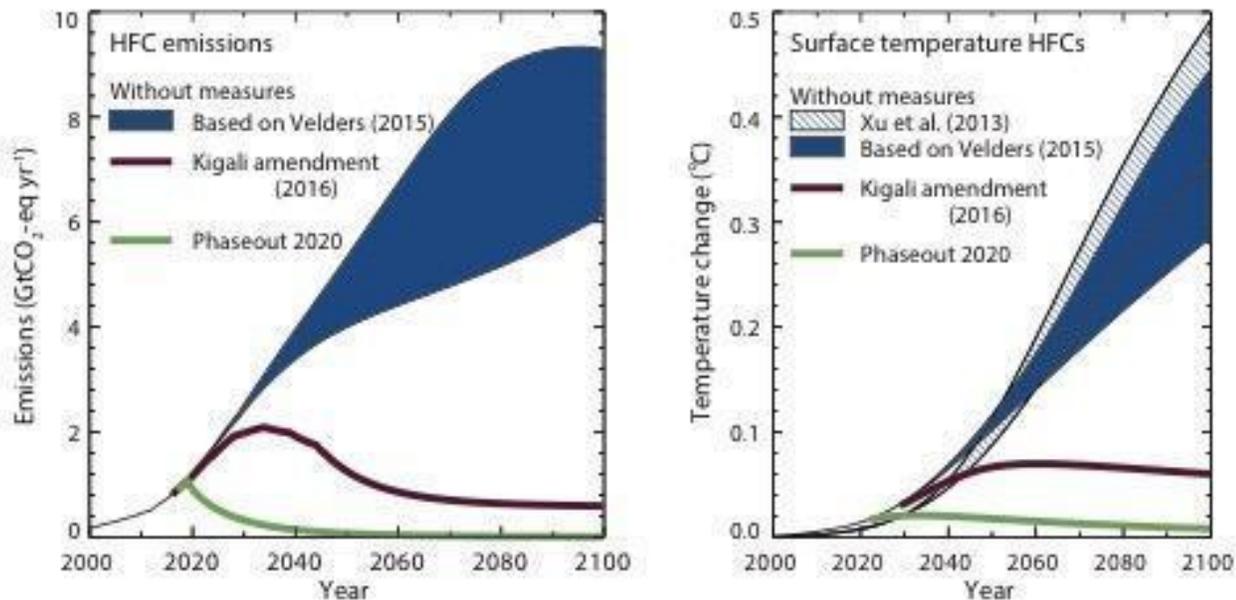

Source: Velders, Guus J.M., David W. Fahey, John S. Daniel, Stephen O Andersen, and Mack McFarland. (2015). Future atmospheric abundances and climate forcings from scenarios of global and regional hydrofluorocarbon (HFCs) emissions. *Atmospheric Environment* 123, 200–209.

<http://www.sciencedirect.com/science/article/pii/S135223101530488X>. doi:
<https://doi.org/10.1016/j.atmosenv.2015.10.071>.

FIGURE 2: HFCS ARE NOW BEING PHASED DOWN UNDER THE KIGALI AMENDMENT TO THE MONTREAL PROTOCOL

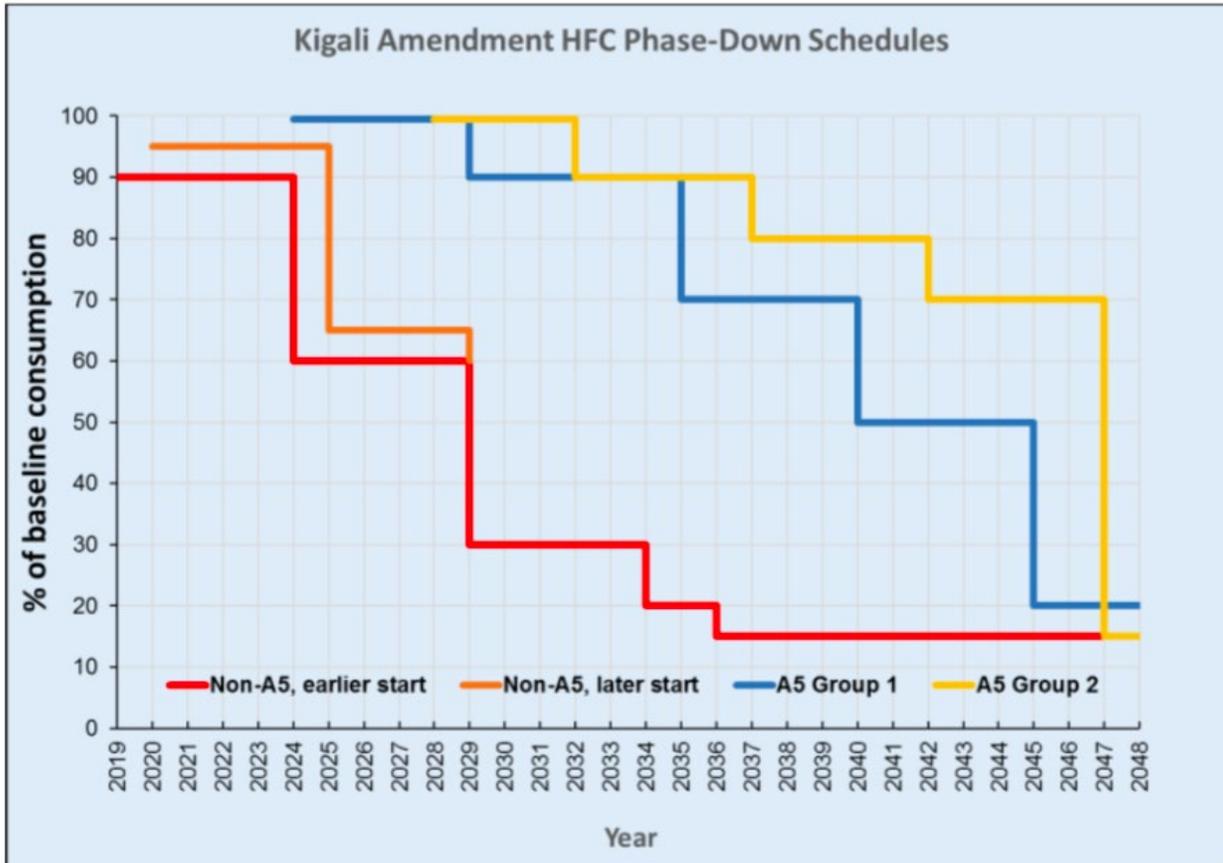

“Article 5” or A5 countries are typically developing countries. “Non-Article 5” countries are developed countries. It is the tradition of the Montreal Protocol to accelerate the control schedule as technology is made available, which is absolutely required to avoid Polar tipping points

STRATOSPHERIC OZONE AND CLIMATE SCIENCE

- Salawitch, Ross J. (Lead Author), David W. Fahey, Michaela I. Hegglin, Laura A. McBride, Walter R. Tribett, Sarah J. Doherty, Twenty Questions and Answers About the Ozone Layer: 2018 Update, Scientific Assessment of Ozone Depletion: 2018, 84 pp., World Meteorological Organization, Geneva, Switzerland, 2019.
- World Meteorological Organization (WMO), National Oceanic and Atmospheric Administration (NOAA), United Nations Environment Programme (UNEP), National Aeronautics and Space Administration (NASA) and the European Commission (EC). 2018. Scientific Assessment of Ozone Depletion. 2018. WMO Global Ozone Research and Monitoring Project – Report No. 58, 67 pp., Geneva, Switzerland. <https://ozone.unep.org/sites/default/files/2019-05/SAP-2018-Assessment-report.pdf>.

HFC SCIENCE AND POLICY

- Zaelke, Durwood, Nathan Borgford-Parnell, and Stephen O. Andersen (Lead Authors), Kristin Campbell, Xiaopu Sun, Dennis Clare, Claire Phillips, Stela Herschmann, Yuzhe

Procurement Recommendations for Climate Friendly Refrigerants

Peng Ling, Alex Milgroom, and Nancy J. Sherman (Contributing Authors. 2018. Primer on HFCs: Fast action under the Montreal Protocol can limit growth of hydrofluorocarbons (HFCs), prevent 100 to 200 billion tonnes of CO₂-eq by 2050, and avoid up to 0.5°C of warming by 2100. <http://www.igsd.org/wp-content/uploads/2018/01/HFC-Primer-v11Jan18.pdf>.

KIGALI AMENDMENT

- UNEP. 2016. Frequently asked questions relating to the Kigali Amendment to the Montreal Protocol. https://ec.europa.eu/clima/sites/clima/files/faq_kigali_amendment_en.pdf.

US EPA GUIDANCE ON ALTERNATIVES TO HFCS

- <https://www.epa.gov/ozone-layer-protection/transitioning-low-gwp-alternatives-commercial-refrigeration>
- <https://www.epa.gov/snap/transitioning-low-gwp-alternatives-residential-and-light-commercial-air-conditioning>
- <https://www.epa.gov/snap/transitioning-low-gwp-alternatives-domestic-refrigeration>
- <https://www.epa.gov/ozone-layer-protection/transitioning-low-gwp-alternatives-building-and-construction-foams>
- <https://www.epa.gov/ozone-layer-protection/transitioning-low-gwp-alternatives-unitary-air-conditioning>
- <https://www.epa.gov/ozone-layer-protection/transitioning-low-gwp-alternatives-transport-refrigeration>
- <https://www.epa.gov/snap/transition-low-gwp-alternatives-passenger-vehicle-air-conditioners>

CONSUMER GOODS FORUM RETAIL HFC PHASEOUT RESOLUTION AND CASE STUDIES

- Refrigeration: Taking action to mobilize resources to phase out high GWP refrigerants, <https://www.theconsumergoodsforum.com/initiatives/environmental-sustainability/key-projects/refrigeration/>

CALIFORNIA AIR RESOURCES BOARD (CARB) HFC PHASEDOWN ADVICE

- CARB. Choosing a New System? Alternatives are increasingly available to replace high-GWP refrigerant technologies. <https://ww2.arb.ca.gov/resources/documents/choosing-new-system>

ACRONYMS

AC	air conditioning (air conditioners)
ACCA	Air Conditioning Contractors of America
ACCA QI	Air Conditioning Contractors of America Quality Installation
AR4	Assessment Report 4 (of the Intergovernmental Panel on Climate Change)
AR5	Assessment Report 5 (of the Intergovernmental Panel on Climate Change)
ASHRAE	American Society of Heating, Refrigerating and Air-Conditioning Engineers
AHRI	Air Conditioning, Heating & Refrigeration Institute
CARB	California Air Resources Board
CCAC	Climate and Clean Air Coalition
CFC	Chlorofluorocarbon
CO ₂	carbon dioxide
COP	Coefficient of Performance
EER	Energy Efficiency Ratio
EPA	Environmental Protection Agency (US)
GHG	greenhouse gas
GWP	global warming potential
HCFC	hydrochlorofluorocarbon
HFC	hydrofluorocarbon
HFO	hydrofluoroolefin
IGSD	Institute for Governance & Sustainable Development
IPCC	Intergovernmental Panel on Climate Change
LCCP	Life Cycle Climate Performance
MACS	Mobile Air Conditioning Society Worldwide
MVAC	motor vehicle air conditioning
NOAA	National Oceanographic and Space Administration
NRDC	Natural Resources Defense Council
ODP	ozone-depletion potential
ODS	ozone-depleting substance
RACHP	refrigeration, air conditioning, and heat pump
RAD	Responsible Appliance Disposal (partnership)
RTOC	Refrigeration, Air Conditioning and Heat Pumps Technical Options Committee
SAE	Society of Automotive Engineers
SAP	Scientific Assessment Panel (of the UNEP Montreal Protocol)
SEER	Seasonal Energy Efficiency Rating
SFTA	Sustainable Food Trade Association
SNAP	Significant New Alternative Policy Program (US EPA)
SPLC	Sustainable Purchasing Leadership Council
TEAP	Technology and Economic Assessment Panel (of the UNEP Montreal Protocol)
TT&C	technician training & certification
UNEP	United Nations Environment Programme
US	United States
WMO	World Meteorological Organization